



P.O. Box 1026
Crossville, TN 38557
Ph. 931-484-7541
www.uplanddesigngroup.com

Addendum No. 2, Feb. 17, 2026

Re: Tennessee Technological University
Hooper Eblen Center Sound System Replacement
SBC Project No. 364/011-03-2025

From: Upland Design Group PLLC
P.O. Box 1026 (38557)
362 Industrial Blvd.
Crossville, TN 38555
Telephone (931) 484 7541
Fax (931) 484 2351

To: Prospective Bidders



This Addendum forms a part of the Contract Documents and modifies the original Bidding Documents dated 2/5/26, as noted below. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject Bidder to disqualification.

This Addendum consists of 1 page and 5 pages of attachments (6 pages total).

Clarifications

- 1) The seating at the rear of the arena in front of the existing walls to receive stretched fabric will remain in place. At the contractor's option, the last row of seating may be removed and reinstalled as required to install the fabric. Replace any seating, brackets or flooring damaged by removal and reinstallation of seating.

Changes to Specifications:

- 1) Refer to Section 09 84 13 Acoustical Panels. Section 2.02 subsection A.1 to read: "1/8" thick acoustic infill FabriBLOK and 3" thick, TerraCORE Poly infill; black color. Acoustical testing rating between 1.0 and 1.1 NCR."
- 2) Refer to Section 09 84 13 Acoustical Panels. Section 2.02 subsection A.2 to read: "Facing Material: Cloth woven 100% polyester fabric similar to FabriSPAN classic, waterfall, or weave or approved equal. Fire testing E84 Class A fabric."

Changes to Drawings:

- 3) Refer to Cover sheet. Add Sheet Issue Date, Current Revision, Current Revision Date column to the Index to drawings. See attached revised Cover Sheet.
- 4) Refer to Sheet A1.1 Floor Plan – Main Level. Revise Floor Plan Key Notes, subsection A. Change the acoustic testing of the wall panels to read 1.0 to 1.1 NRC.
- 5) Refer to Sheet A2.1 Reflected Ceiling Plan. Revise Legend of Symbols and Speaker Array Locations and Weights legend to remove any reference to modification of the structure. See revised A2.1 sheet for wording on those legends.
- 6) Refer to sheets A3.1 and A3.2 Building Sections / Interior Elevations. On Section Key Notes Item A, change the acoustic testing of the wall panels to read 1.0 to 1.1 NRC.

END OF ADDENDUM

TENNESSEE TECHNOLOGICAL UNIVERSITY


HOOPER EBLIN CENTER SOUND SYSTEM REPLACEMENT

SBC N° 364/011-03-2025

COOKEVILLE, PUTNAM COUNTY, TN


1100 McGEE BLVD.
COOKEVILLE, TN 38501

REGULATORY REQUIREMENTS	
LISTED BELOW ARE THE REGULATORY REQUIREMENTS THAT APPLY TO THIS PROJECT. REFER TO SECTION 01 41 14 REGULATORY REQUIREMENTS. THIS LIST IS PROVIDED AS A CONVENIENCE TO THE CONTRACTOR AND IS NOT TO BE CONSIDERED ALL INCLUSIVE OF CODES AND REGULATIONS THAT MAY APPLY. THE CONTRACTOR SHALL COMPLY WITH ALL PERTINENT CODES, STANDARDS, REGULATIONS AND LAWS.	
<p>(1) INTERNATIONAL BUILDING CODE (IBC), 2021 EDITION, PUBLISHED BY THE INTERNATIONAL CODE COUNCIL (ICC), REMOVE CHAPTER 11 ACCESSIBILITY, THE REQUIREMENTS OF SECTION 423 STORM SHELTERS SHALL NOT BE REQUIRED, SEE FIRE MARSHAL ADOPTED CODES APPENDIX FOR AMENDMENTS;</p> <p>(2) THE INTERNATIONAL FIRE CODE (IFC), 2021 EDITION, PUBLISHED BY THE INTERNATIONAL CODE COUNCIL (ICC);</p> <p>(3) THE INTERNATIONAL ELECTRICAL CODE (IEC), 2021 EDITION, PUBLISHED BY THE INTERNATIONAL CODE COUNCIL (ICC);</p> <p>(4) THE INTERNATIONAL PLUMBING CODE (IPC), 2021 EDITION, PUBLISHED BY THE INTERNATIONAL CODE COUNCIL (ICC);</p> <p>(5) THE INTERNATIONAL PROPERTY MAINTENANCE CODE (IPMC), 2021 EDITION, PUBLISHED BY THE INTERNATIONAL CODE COUNCIL (ICC), SEE FIRE MARSHAL ADOPTED CODES APPENDIX FOR AMENDMENTS;</p> <p>(6) THE INTERNATIONAL FIRE CODE (IFC), 2021 EDITION, PUBLISHED BY THE INTERNATIONAL CODE COUNCIL (ICC), SEE FIRE MARSHAL ADOPTED CODES APPENDIX FOR AMENDMENTS;</p> <p>(7) THE INTERNATIONAL ENERGY CONSERVATION CODE (IECC), 2021 EDITION, PUBLISHED BY THE INTERNATIONAL CODE COUNCIL (ICC), SEE FIRE MARSHAL ADOPTED CODES APPENDIX FOR AMENDMENTS;</p> <p>(8) THE NATIONAL ELECTRICAL CODE (NEC), 2017 EDITION, PUBLISHED BY THE NFPA, EXCEPT THAT:</p> <ol style="list-style-type: none"> 1. SECTION 110.24, AVAILABLE FAULT CURRENT SHALL BE OPTIONAL; 2. ALL FAULT TOLERANT INTERCIRCUIT (ATC) SHALL BE OPTIONAL FOR THEATRE, LAUNDRY AREAS, GARAGES, UNFINISHED BASEMENTS, WHICH ARE PORTIONS OR AREA OF THE BUILDING NOT MEANT FOR HABITABLE ROOMS AND LIMITED TO STORAGE, WORK OR SIMILAR AREA, AND FOR BRANCH CIRCUITS DEDICATED TO SUPPLYING REFRIGERATION EQUIPMENT. <p>(9) NO PROVISION OF THE PRECEDING CITED PUBLICATIONS SHALL BE ADOPTED THAT CONFLICTS WITH:</p> <ol style="list-style-type: none"> 1. THE INSTALLATION AND SERVICE STANDARDS OF PORTABLE FIRE EXTINGUISHERS AND FIXED FIRE EXTINGUISHERS SYSTEMS IN TENN. COMP. R. & REGS. 0780-02-14-.02; AND 2. THE STANDARDS FOR ENGAGING IN THE LIQUEFIED PETROLEUM GAS BUSINESS IN TENN. COMP. R. & REGS. 0780-02-17-.02. 	

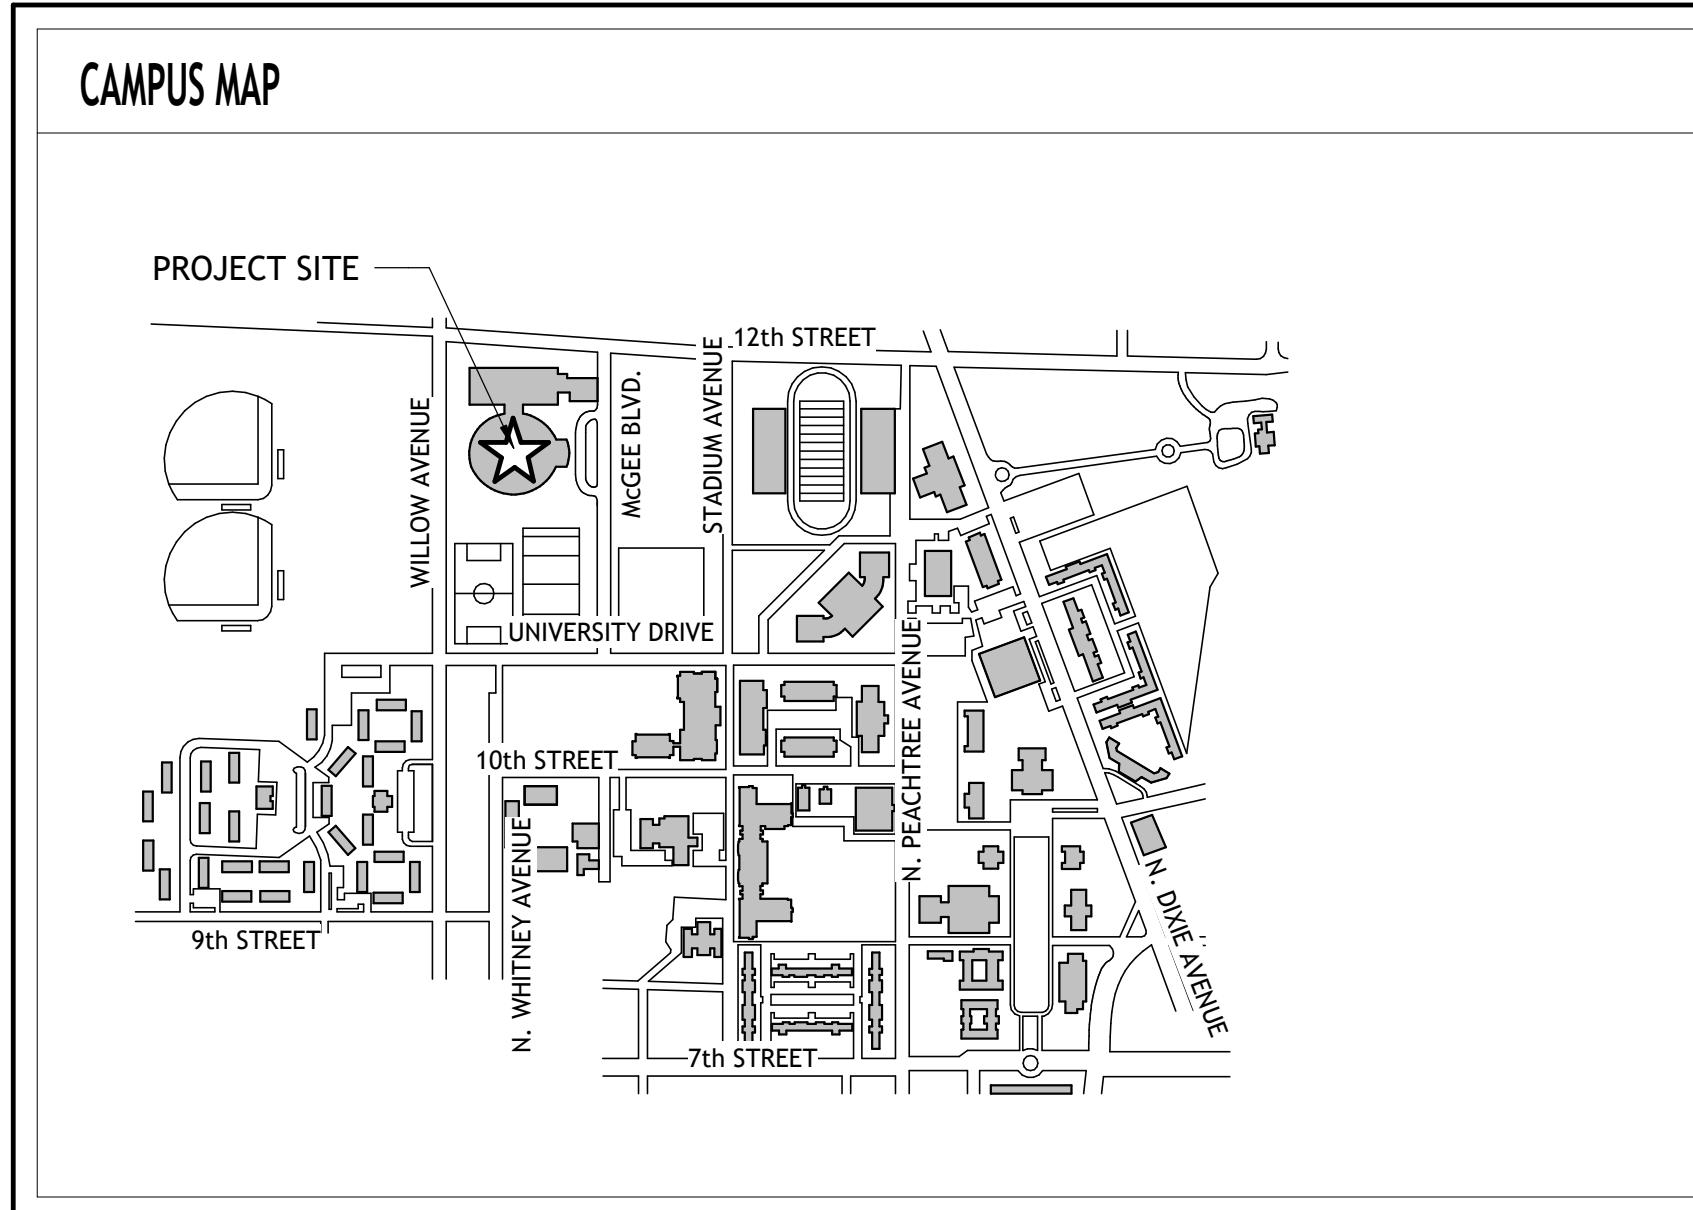

INDEX TO DRAWINGS				
Sheet Number	Sheet Name	Sheet Issue Date	Current Revision	Current Revision Date
COVER	Cover	02/05/2026	1	02/17/2026
ARCHITECTURAL DRAWINGS				
A1.1	FLOOR PLAN - MAIN LEVEL	02/05/2026	1	02/17/2026
A1.2	FLOOR PLAN - CAT WALK	02/05/2026	1	02/17/2026
A2.4	REFLECTED CEILING PLAN	02/05/2026	1	02/17/2026
A3.1	BUILDING SECTIONS / INTERIOR ELEVATIONS	02/05/2026	1	02/17/2026
A3.2	BUILDING SECTIONS / INTERIOR ELEVATIONS	02/05/2026	1	02/17/2026
A4.1	WALL SECTION	02/05/2026		
ELECTRICAL DRAWINGS				
E0.1	ELECTRICAL NOTES AND LEGENDS	02/05/2026		
E1.1	ELECTRICAL PLAN - MAIN LEVEL	02/05/2026		
E1.2	ELECTRICAL PLAN - CATWALK LEVEL	02/05/2026		

CODE DATA	CODE DATA CONTINUED
OCCUPANCY TYPE - B - BUSINESS (IBC 2021 SECTION 304.1) A-4 - ASSEMBLY GROUP (IBC 2021 SECTION 303.4)	
CONSTRUCTION TYPE - IIB UNSPRINKLED (IBC TABLES 502/601) RISK CATEGORY (IBC TABLE 1604.5) - III - BUILDINGS AND OTHER STRUCTURES CONTAINING ADULT EDUCATION FACILITIES, SUCH AS COLLEGES AND UNIVERSITIES, WITH AN OCCUPANT LOAD GREATER THAN 500. ANY OTHER OCCUPANCY WITH AN OCCUPANT LOAD GREATER THAN 5,000.	
IIBC 2021 - CLASSIFICATION OF WORK IBC 2021 - 603.1 - ALTERATION - LEVEL 2: INCLUDE THE ADDITION OR ELIMINATION OF ANY DOOR OR WINDOW, THE RECONFIGURATION OR EXTENSION OF ANY SYSTEM, OR THE INSTALLATION OF ANY ADDITIONAL EQUIPMENT, AND SHALL APPLY WHERE THE WORK AREA IS EQUAL TO OR LESS THAN 50 PERCENT OF THE BUILDING AREA.	
IBC 2021 - 701.2 - AN EXISTING BUILDING OR PORTION THEREOF SHALL NOT BE ALTERED SUCH THAT THE BUILDING BECOMES LESS SAFE THAN ITS EXISTING CONDITION.	
IBC 2021 702.1 - INTERIOR FINISHES. NEWLY INSTALLED INTERIOR WALL AND CEILING FINISHES SHALL COMPLY WITH CHAPTER 8 OF THE INTERNATIONAL BUILDING CODE.	
IBC 2021 - 803.1 - INTERIOR WALL AND CEILING FINISH MATERIALS SHALL BE CLASSIFIED FOR FIRE PERFORMANCE AND SMOKE DEVELOPMENT IN ACCORDANCE WITH SECTION 803.1.1 OR 803.1.2.	
IBC 2021 - TABLE 803.13 INTERIOR WALL AND CEILING FINISH REQUIREMENTS BY OCCUPANCY	
A-1 OCCUPANCY NONSPRINKLERED - INTERIOR EXIT STAIRWAYS AND RAMPS AND ACCESS STAIRWAYS AND RAMPS - A: CORRIDORS AND ENCLOSURE FOR EXIT ACCESS STAIRWAYS AND RAMPS - A; ROOMS AND ENCLOSED SPACES - C	
B OCCUPANCY NONSPRINKLERED - INTERIOR EXIT STAIRWAYS AND RAMPS AND ACCESS STAIRWAYS AND RAMPS - B; CORRIDORS AND ENCLOSURE FOR EXIT ACCESS STAIRWAYS AND RAMPS - B; ROOMS AND ENCLOSED SPACES - C	


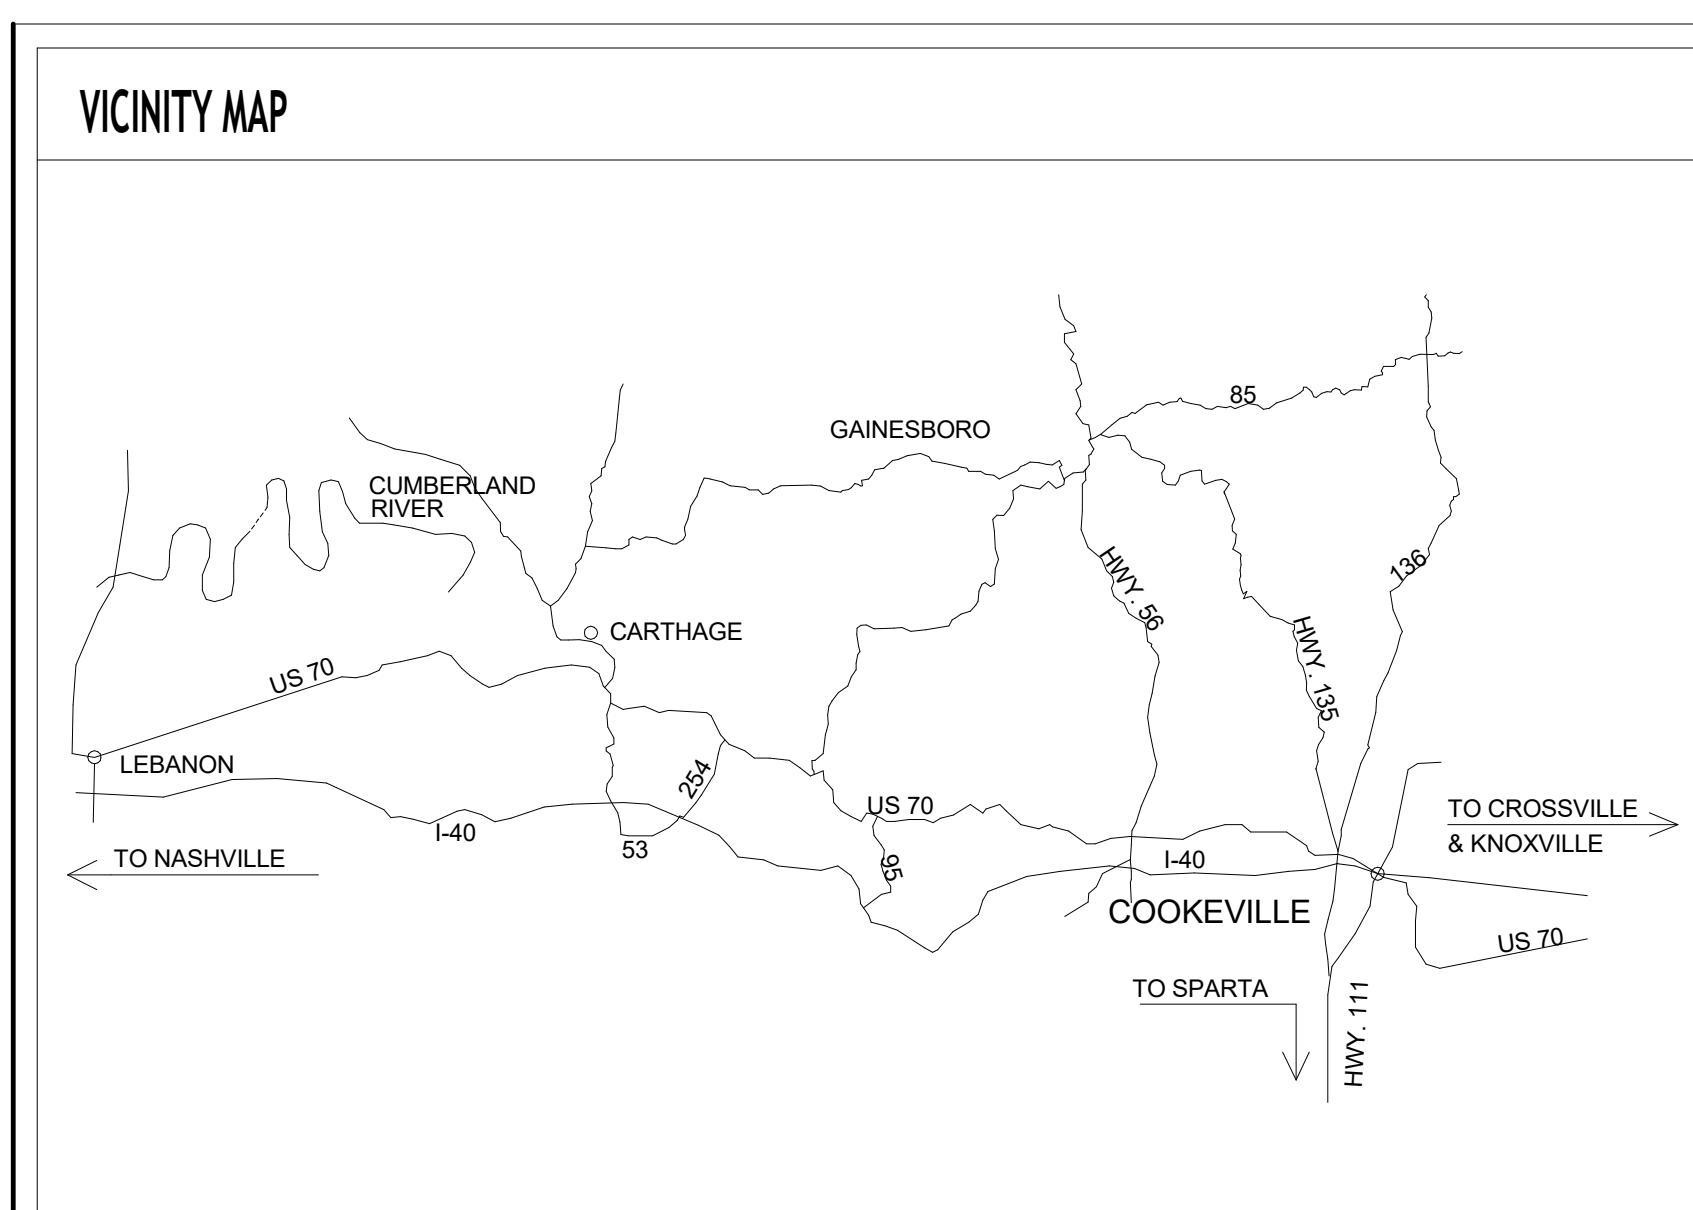


REVISIONS PER CHANGE ORDERS AND SUPPLEMENTAL INSTRUCTIONS		
TYPE (CO / SI)	DATE	DESCRIPTION OF WORK


FIRE RESISTANCE	
FIRE RESISTANCE RATING REQUIREMENTS	
IBC 2021 - TABLE 601	
BUILDING ELEMENTS TYPE II-B	
PRIMARY STRUCTURAL FRAME	0
BEARING WALLS - EXTERIOR (')	0
BEARING WALLS - INTERIOR	0
NON-BEARING WALLS & PARTITIONS (EXTERIOR)	0
NON-BEARING WALLS & PARTITIONS (INTERIOR)	0
FLOOR CONSTRUCTION & ASSOCIATED SECONDARY MEMBERS	0
ROOF CONSTRUCTION & ASSOCIATED SECONDARY MEMBERS	0
f. NOT LESS THAN THE FIRE-RESISTANCE RATING BASED ON FIRE SEPARATION DISTANCE (SEE TABLE 705.5).	
g. NOT LESS THAN THE FIRE-RESISTANCE RATING AS REFERENCED IN SECTION 704.10. - FIRE SEPARATION DISTANCE IS GREATER THAN 30'.	

FIRE-RATED SEPARATION NOTES:		PROJECT SUMMARY STATEMENT		RESPONDING FIRE DEPARTMENT		LOCAL BUILDING INSPECTOR							
REQUIRED SEPARATIONS BETWEEN OCCUPANCIES													
PER IBC 2021 503.1, ALTERATIONS MUST COMPLY WITH IBC PROVISIONS FOR THE ALTERED ELEMENTS AND MAY NOT REDUCE COMPLIANCE OF EXISTING BUILDING FEATURES, SINCE THE WORK IS LIMITED TO SOUND PANELS AND CEILING REACTIONS. THE EXISTING OCCUPANCY SEPARATIONS ARE NOT AFFECTED AND THEREFORE IBC 2021 TABLE 508.4 IS NOT TRIGGERED.													
THE PROPOSED WORK IN THE HOOPER EBLIN CENTER CONSTITUTES A LEVEL 2 ALTERATION PER IBC 2021 603.1, LIMITED TO THE REPLACEMENT OF EXISTING CEILING PANELS, REPAIRS TO THE SPAN OF THE CEILING, AND THE ADDITION OF CEILING ACUSTIC TREATMENT. THESE ALTERATIONS DO NOT AFFECT THE EXISTING OCCUPANCY SEPARATIONS, EXIT PATHS, OR LAYOUT OF THE ASSEMBLY (A-4) AND BUSINESS (B) AREAS. PER 603.1, ALTERATIONS MUST COMPLY WITH IBC REQUIREMENTS ONLY FOR THE ALTERED ELEMENTS AND SHALL NOT REDUCE THE COMPLIANCE OF THE EXISTING BUILDING. THEREFORE, THE EXISTING OCCUPANCY SEPARATIONS BETWEEN THE CONCRETE CONCEALED CONCRETE AND CONCRETE BLOCK, IS NOT REQUIRED TO BE UPGRADED TO THE 2-HOUR SEPARATION INDICATED IN TABLE 508.4 OF THE IBC 2021. ALL NEWLY INSTALLED MATERIALS, INCLUDING ACOUSTIC PANELS AND CEILING TREATMENTS, WILL COMPLY WITH CURRENT IBC MATERIAL REQUIREMENTS FOR FLAME SPREAD AND SMOKE DEVELOPMENT.													
ARCHITECT	ELECTRICAL ENGINEER												
UPLAND DESIGN GROUP, INC.	MAFFETT LOFTIS ENGINEERING	1 SOUTH JEFFERSON AVE, SUITE 101 PO. BOX 998 - 45 EAST BROAD STREET COOKEVILLE, TN 38508 PHONE: 931-520-5266	WWW.UPLANDDESIGNGROUP.COM	COOKEVILLE FIRE DEPARTMENT P.O. BOX 998 - 45 EAST BROAD STREET COOKEVILLE, TN 38508 PHONE: 931-520-5266	COOKEVILLE CITY INSPECTOR - JEREMY GLASCOCK 45 EAST BROAD STREET COOKEVILLE, TN 38501 PHONE: 931-520-5266								


JOB NO.	2518
ISSUE DATE	2-26-26
SHEET TITLE	Cover
DRAWN	CWD
REVIEW	KAC
COVER	KAC

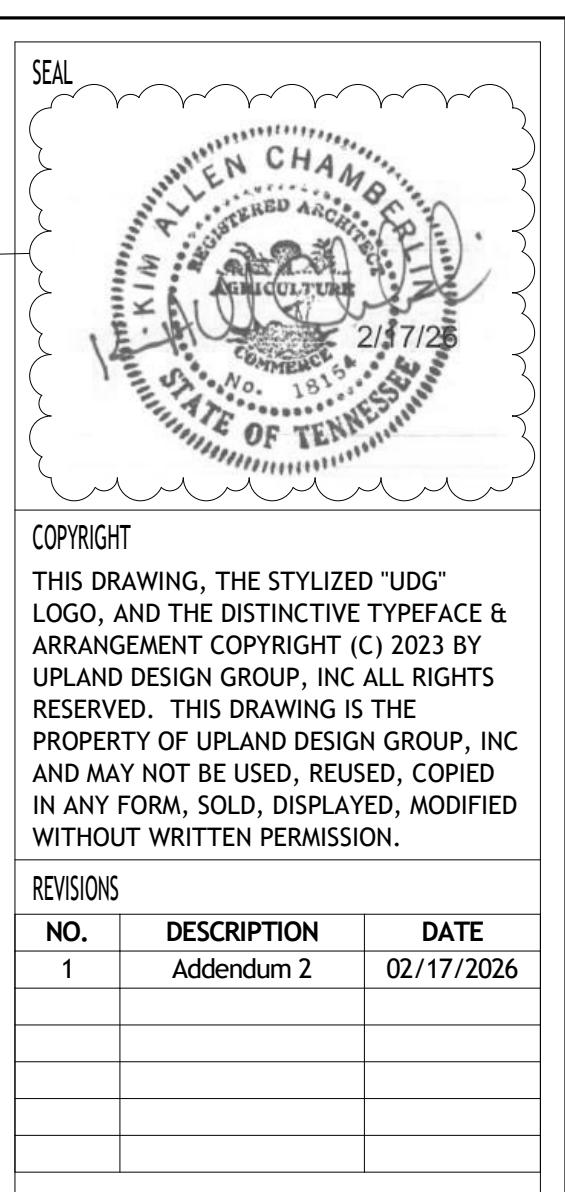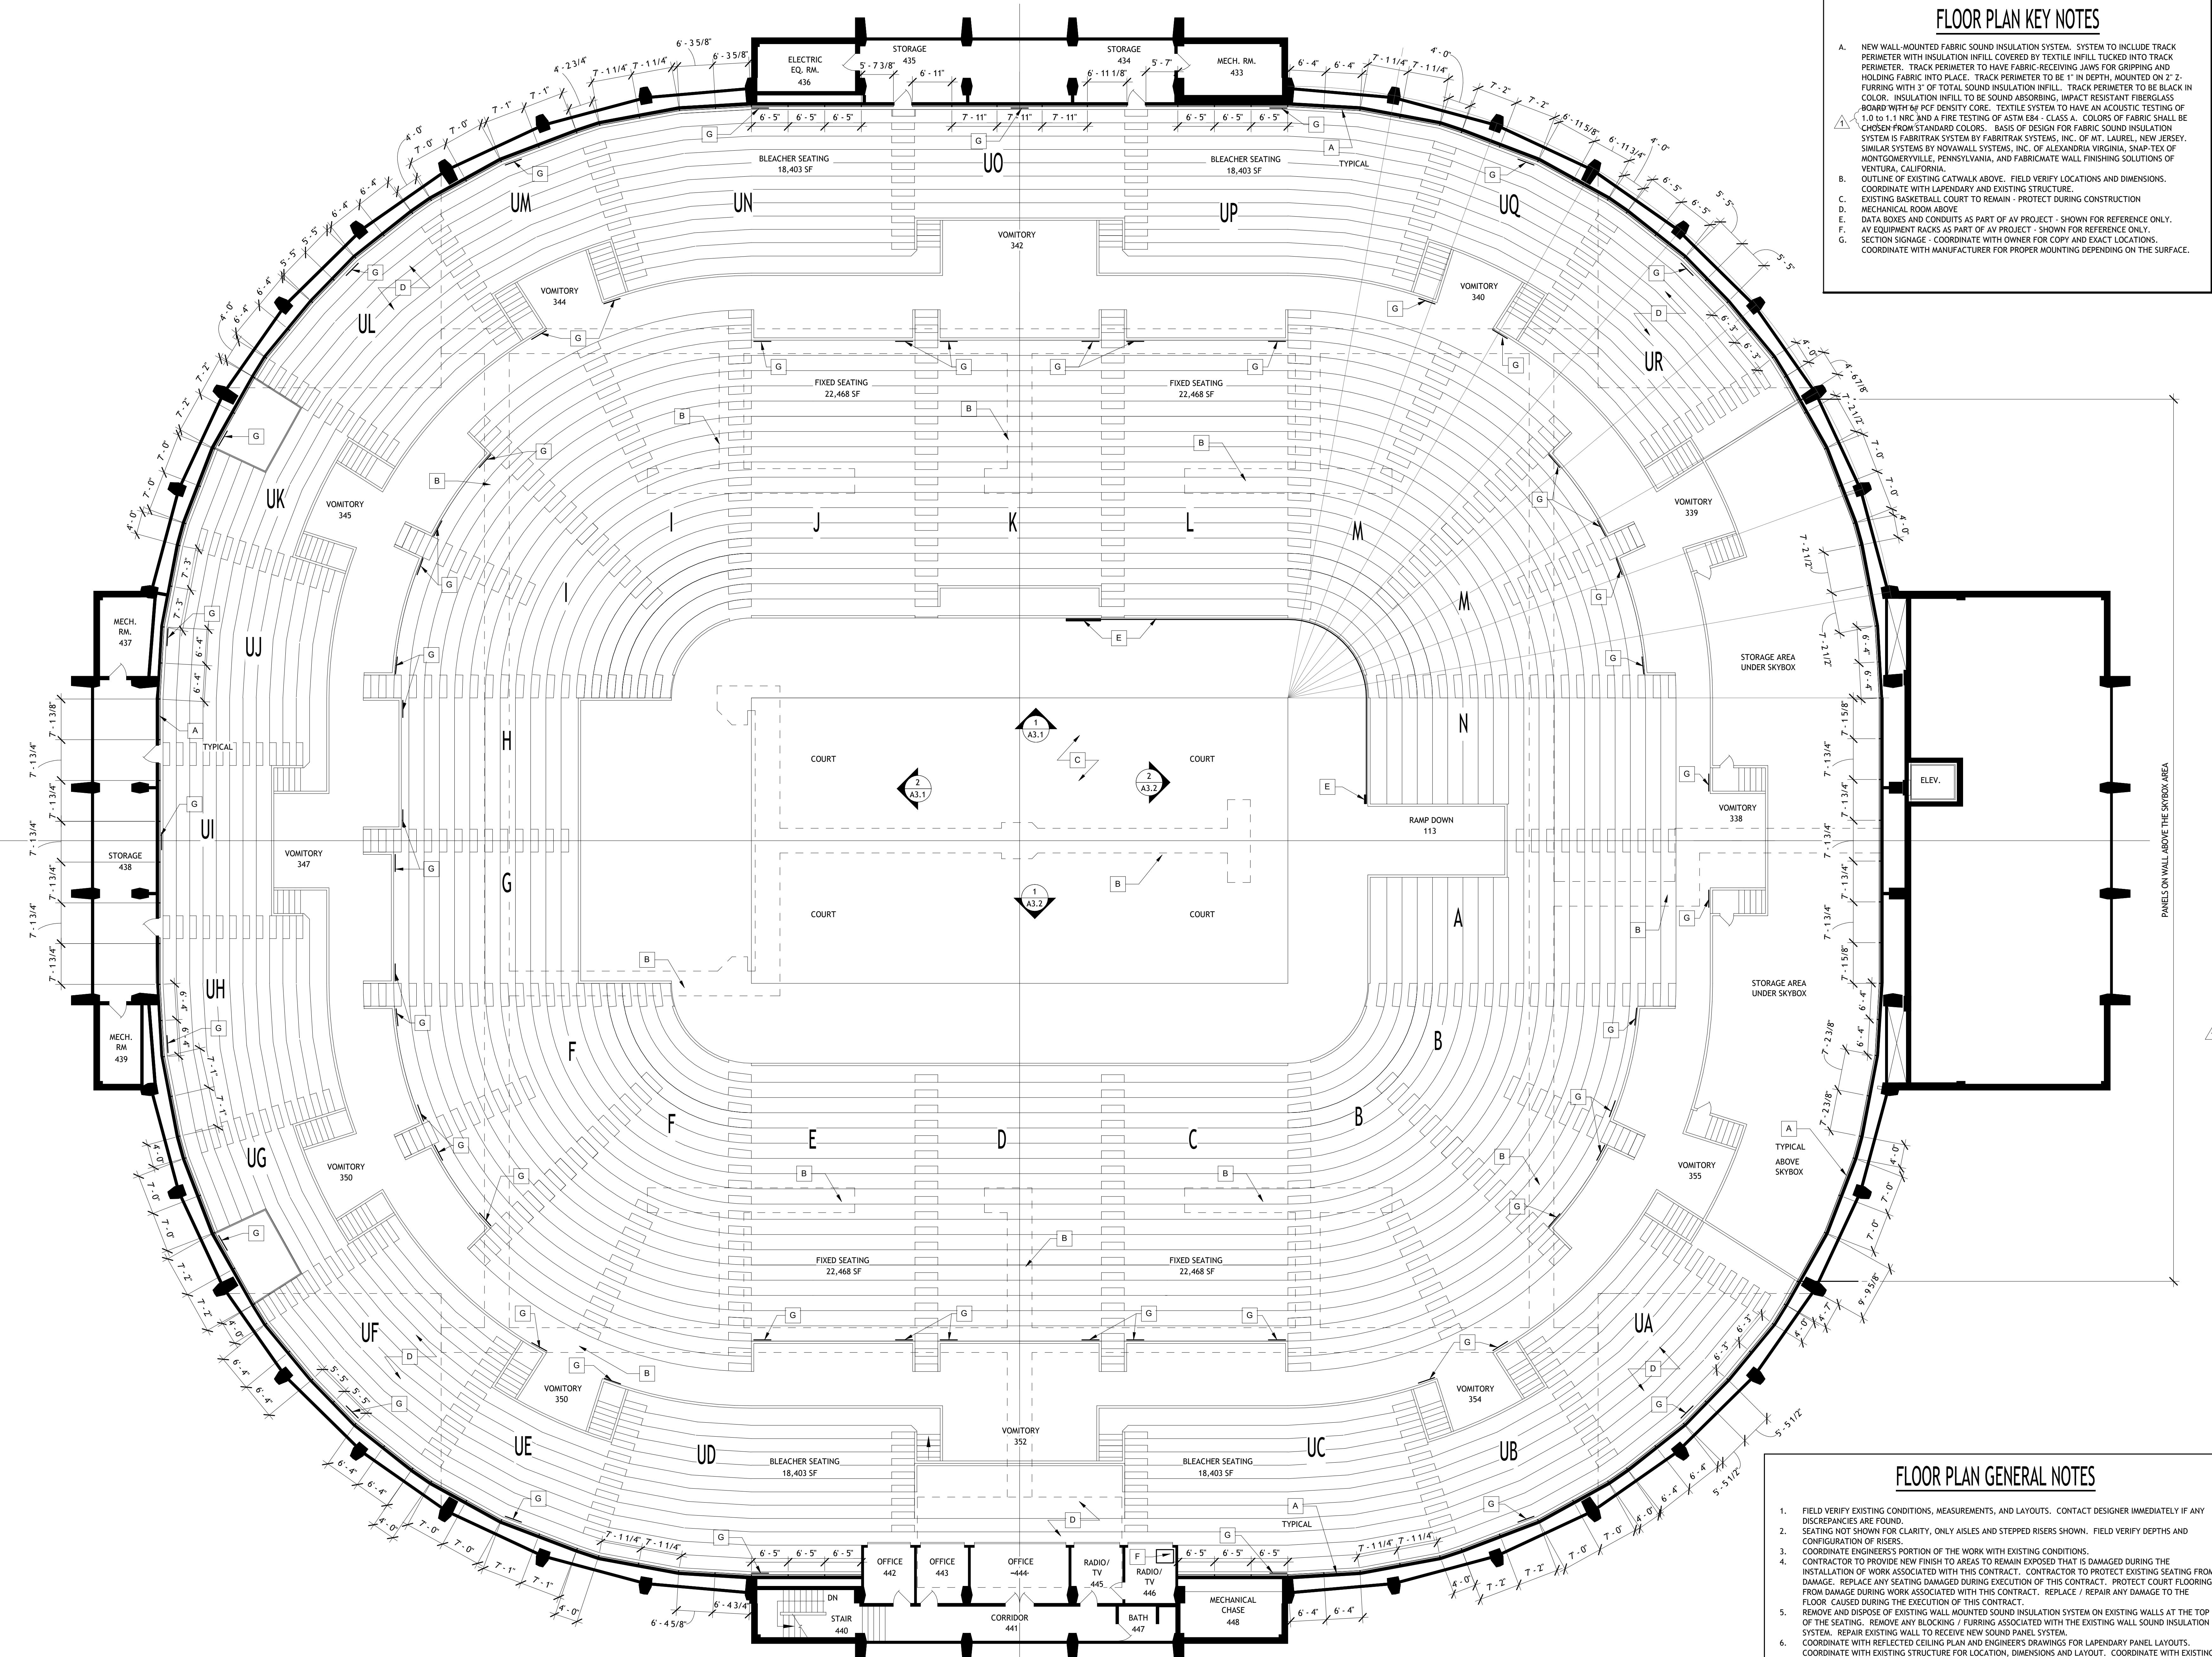

JOB NO.	2518
ISSUE DATE	2-5-26
HEET TITLE	FLOOR PLAN - MAIN LEVEL
DRAWN	CWD
REVIEW	KAC
A1.1	

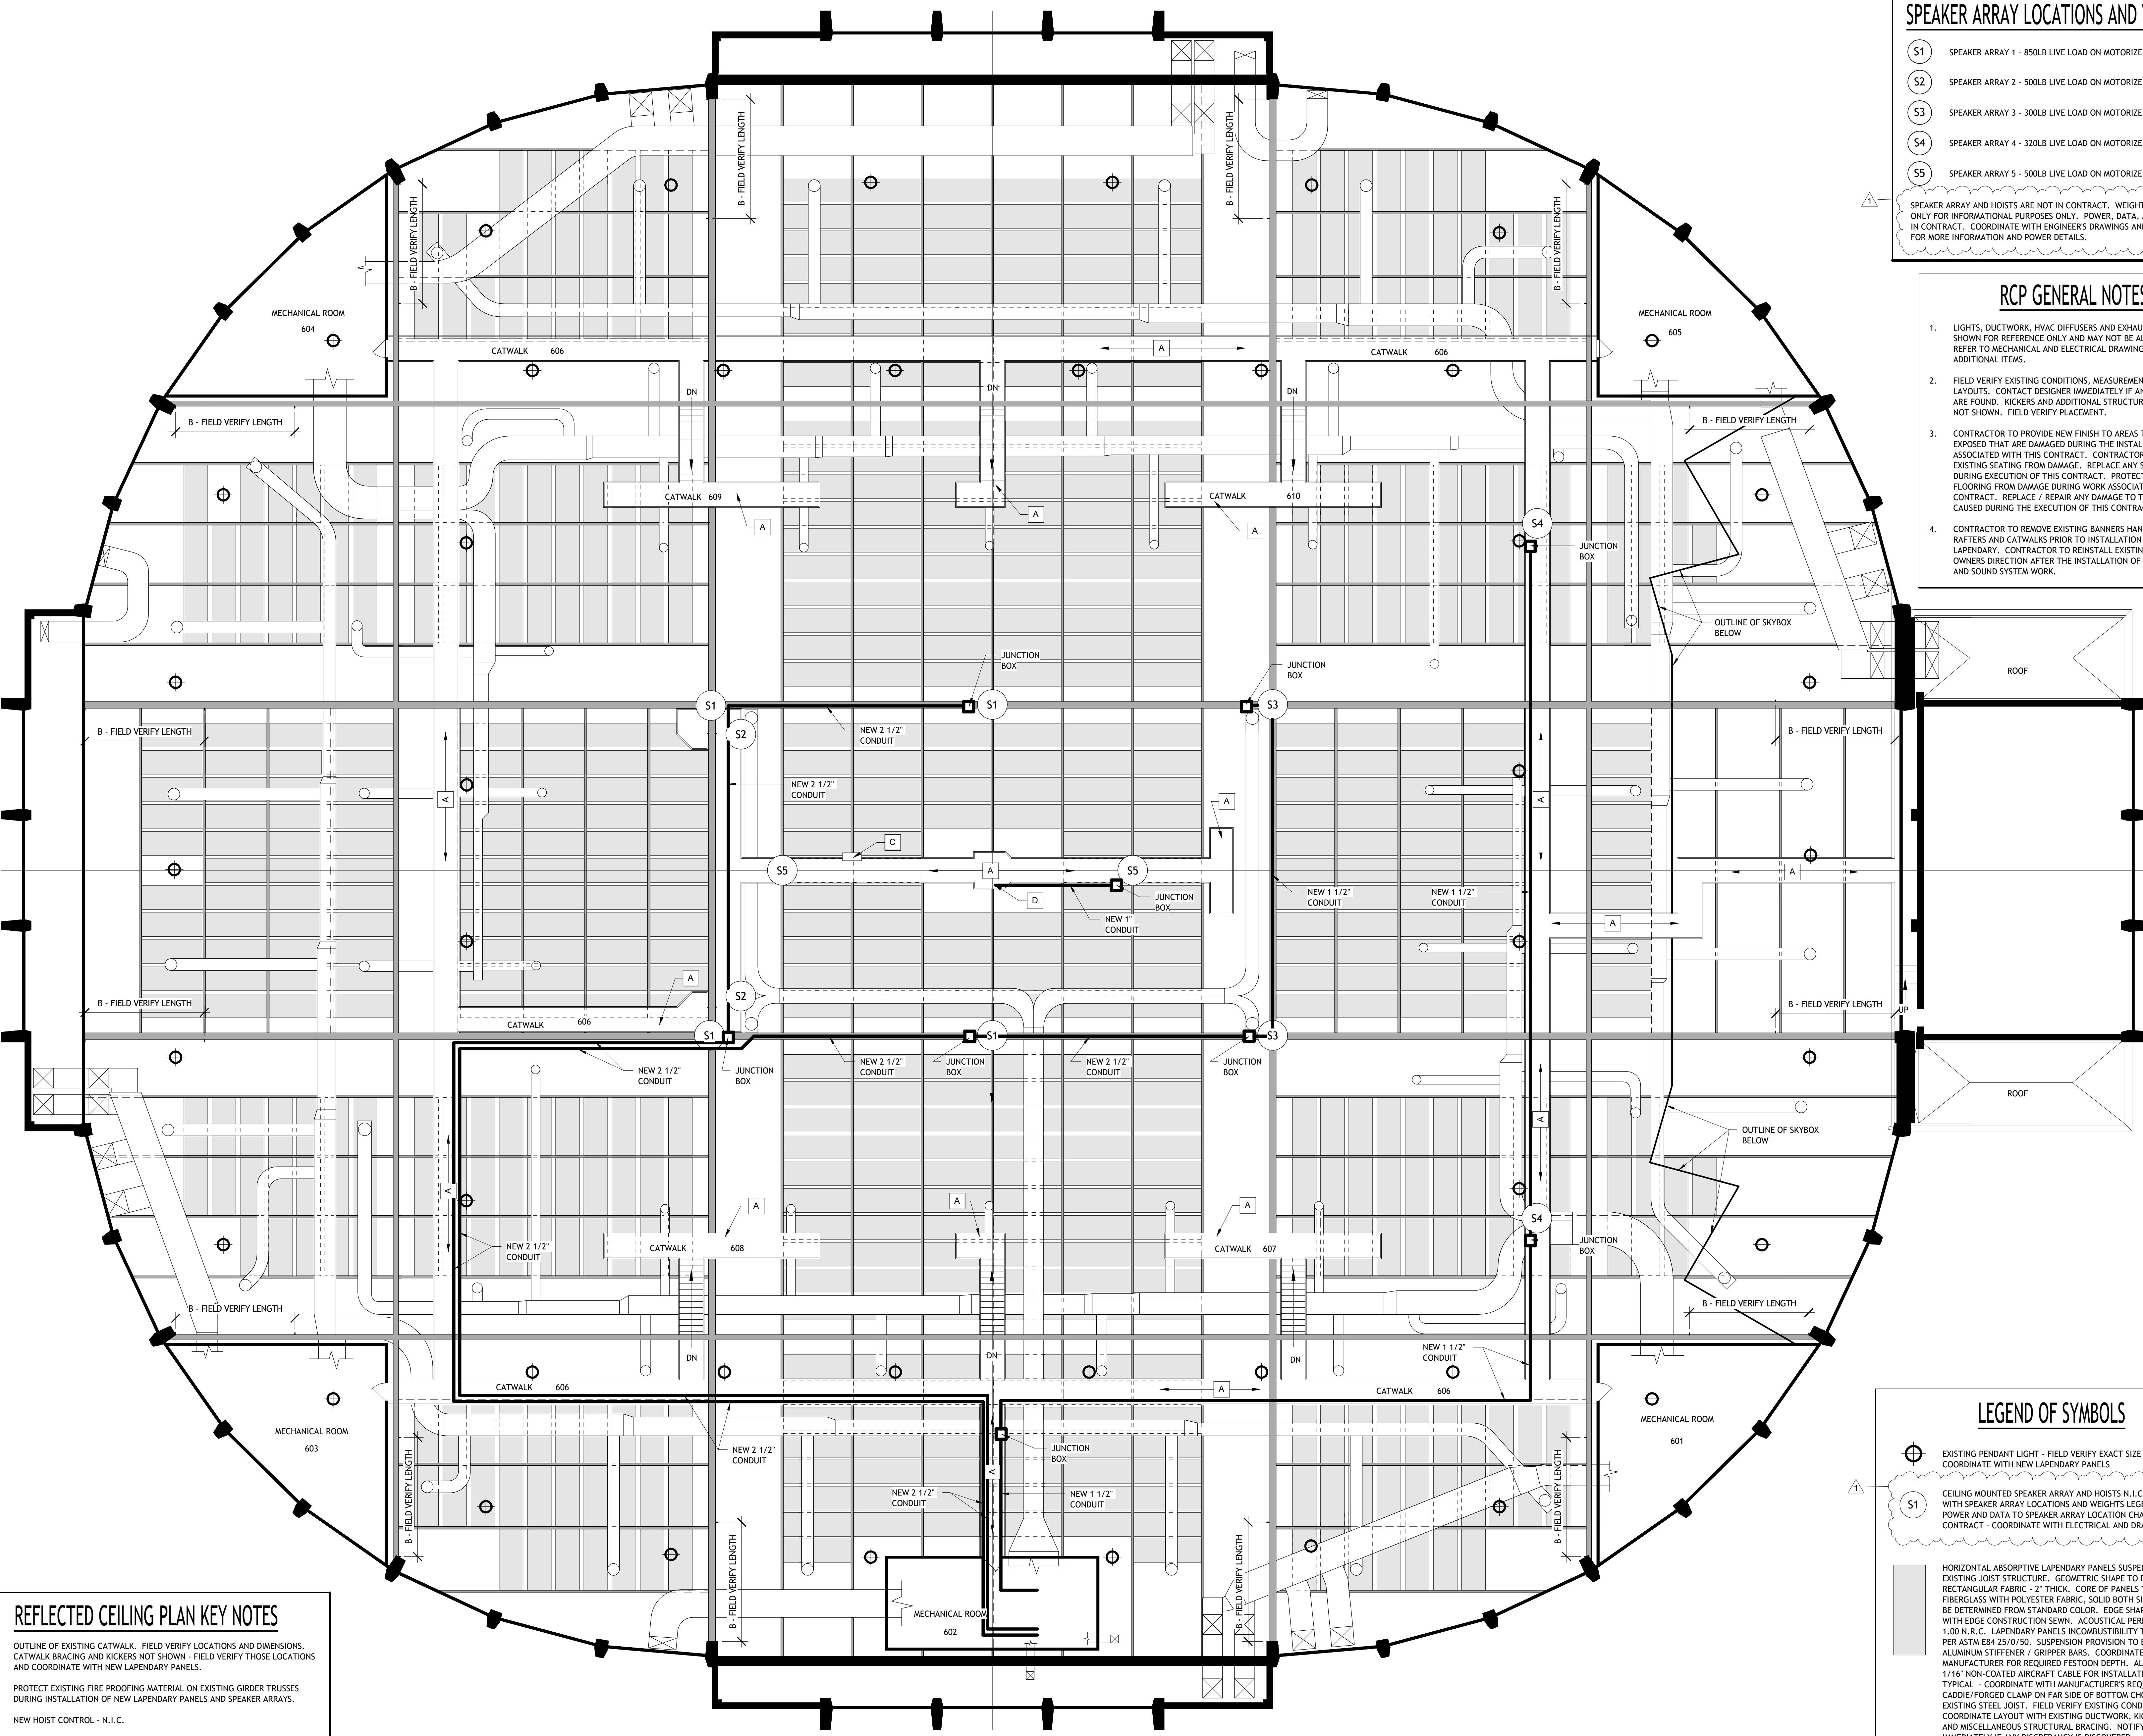

TENNESSEE TECHNOLOGICAL UNIVERSITY
HOOPER EBLEN CENTER SOUND SYSTEM REPLACEMENT
 SBC #364/011-03-2025
 OWNER: TENNESSEE TECHNOLOGICAL UNIVERSITY
 LOCATION: COOKEVILLE, TENNESSEE

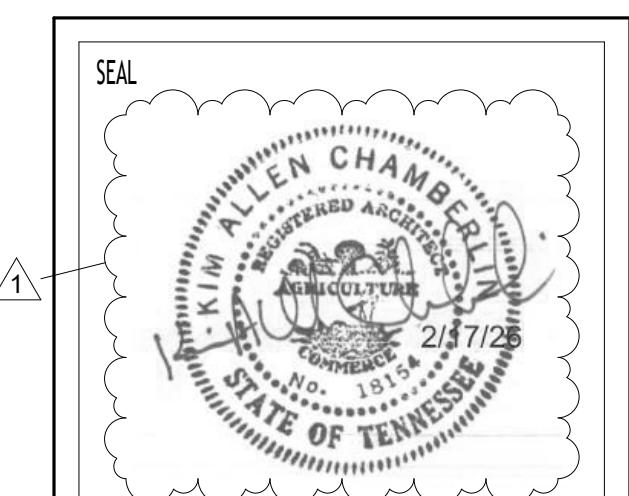

COPYRIGHT
 THIS DRAWING, THE STYLIZED "UDG" LOGO, AND THE DISTINCTIVE TYPEFACE & ARRANGEMENT COPYRIGHT (C) 2023 BY UPLAND DESIGN GROUP, INC. ALL RIGHTS RESERVED. THIS DRAWING IS THE PROPERTY OF UPLAND DESIGN GROUP, INC. AND MAY NOT BE USED, REUSED, COPIED IN ANY FORM, SOLD, DISPLAYED, MODIFIED WITHOUT WRITTEN PERMISSION.


REVISIONS

NO.	DESCRIPTION	DATE
1	Addendum 2	02/17/2026

JOB NO. 2518
ISSUE DATE 2-5-26
 SHEET TITLE REFLECTED CEILING PLAN


DRAWN CWD
REVIEW KAC
A2.1

Upland Design Group
 P.O. BOX 1026
 CROSSVILLE, TN 38557
 Ph. 931.484.7541
www.uplanddesigngroup.com

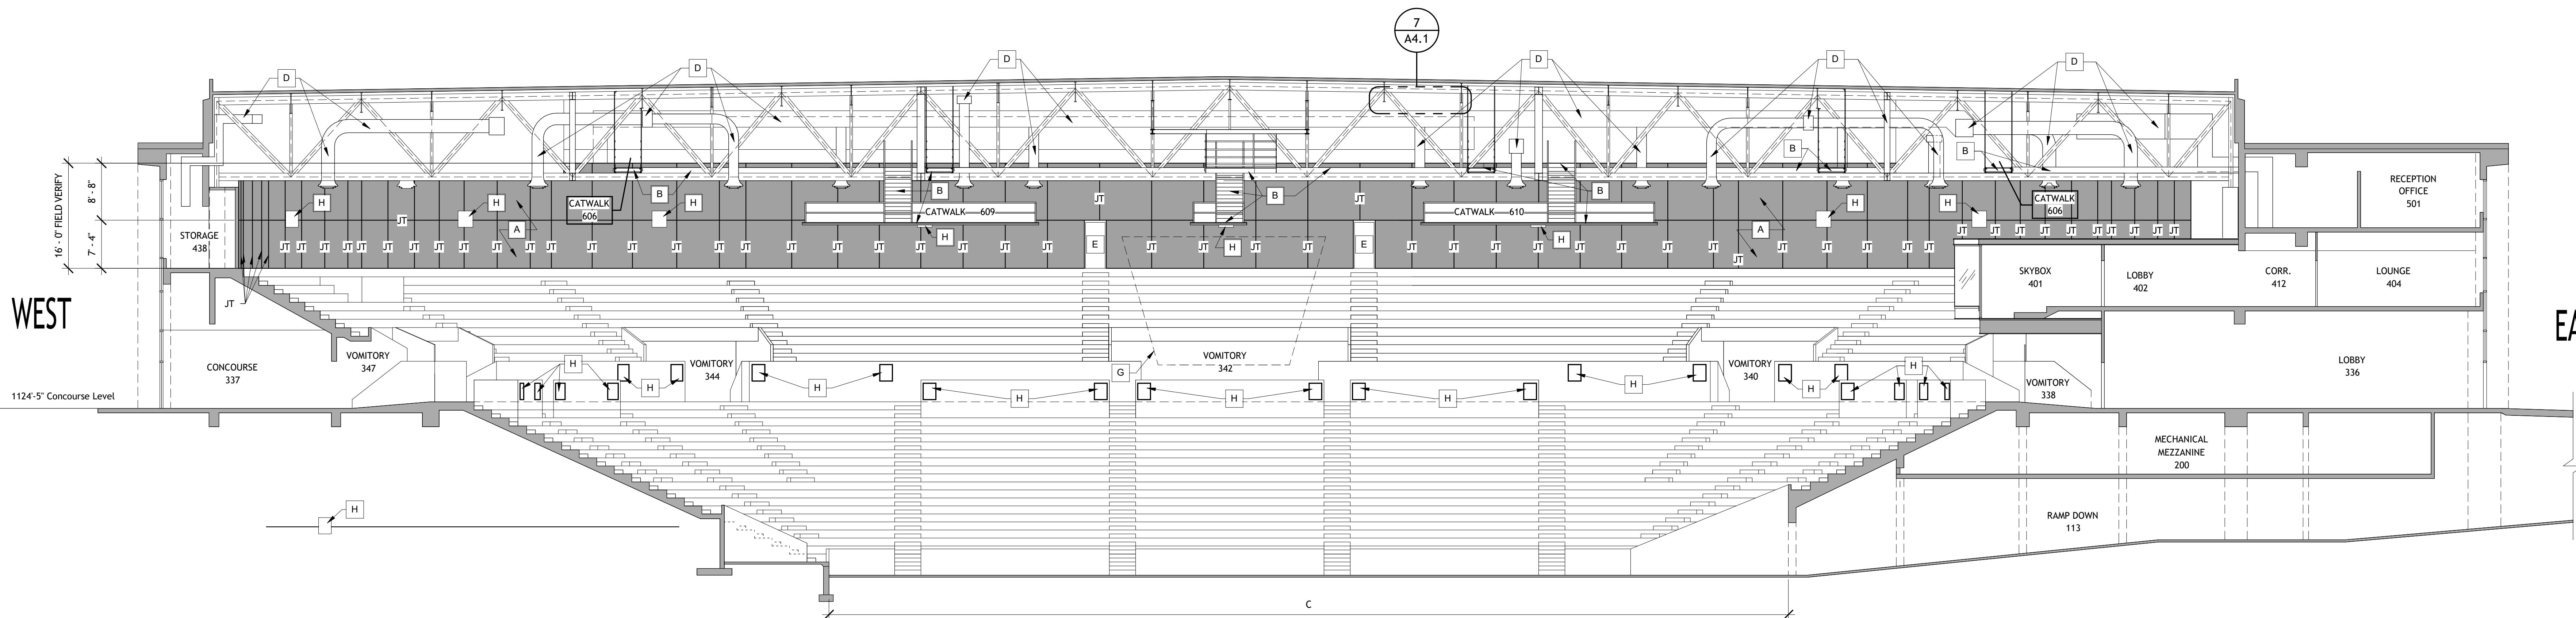




BUILDING SECTION

1

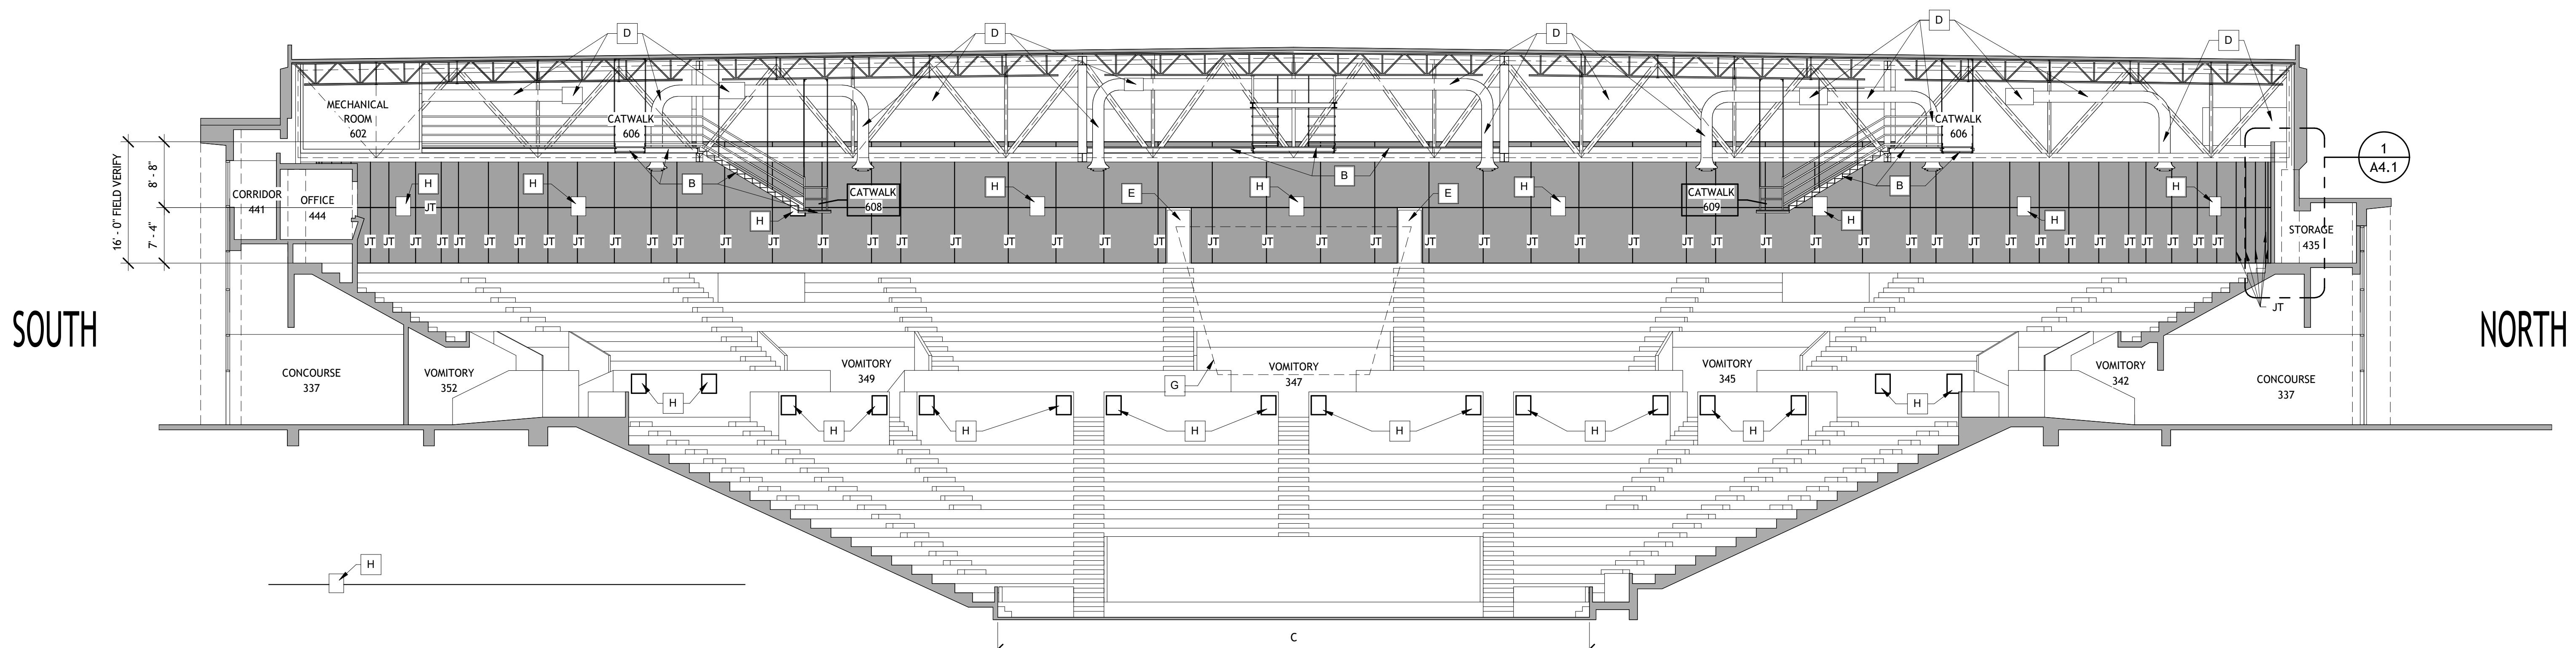


BUILDING SECTION

2

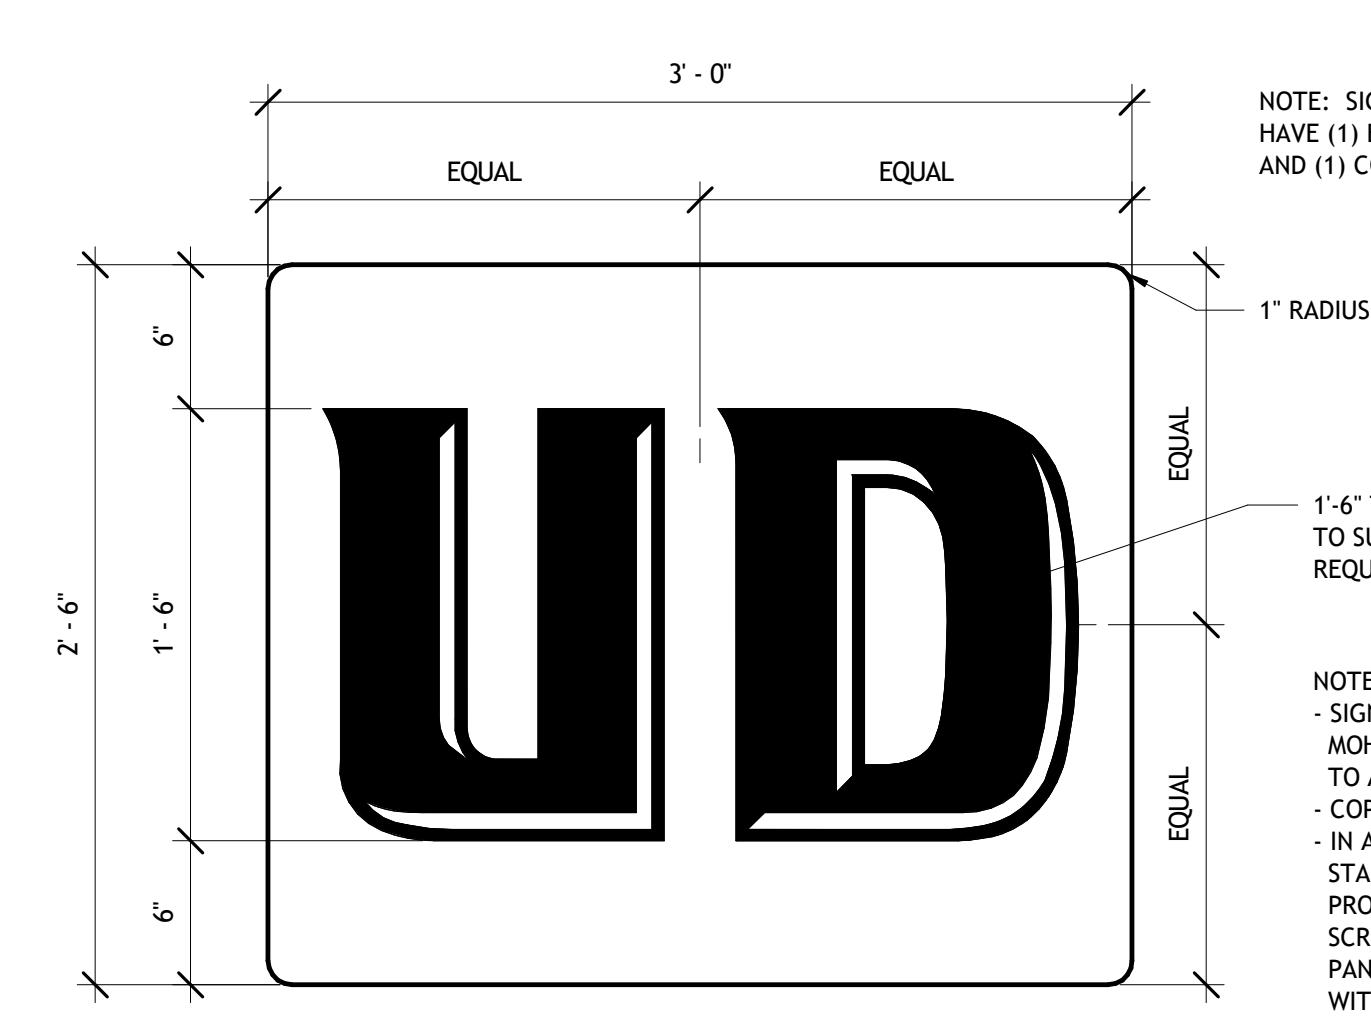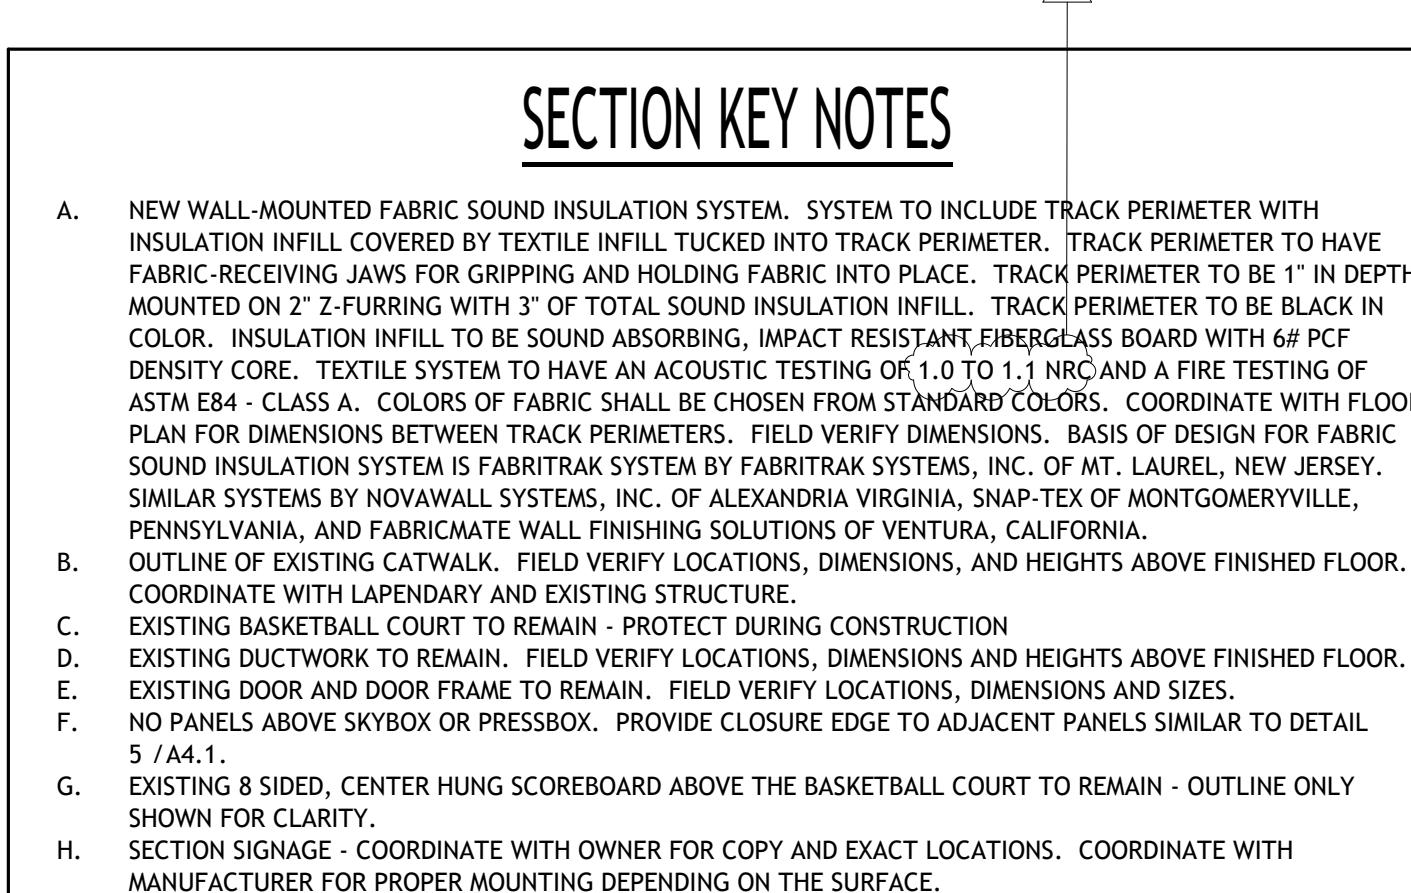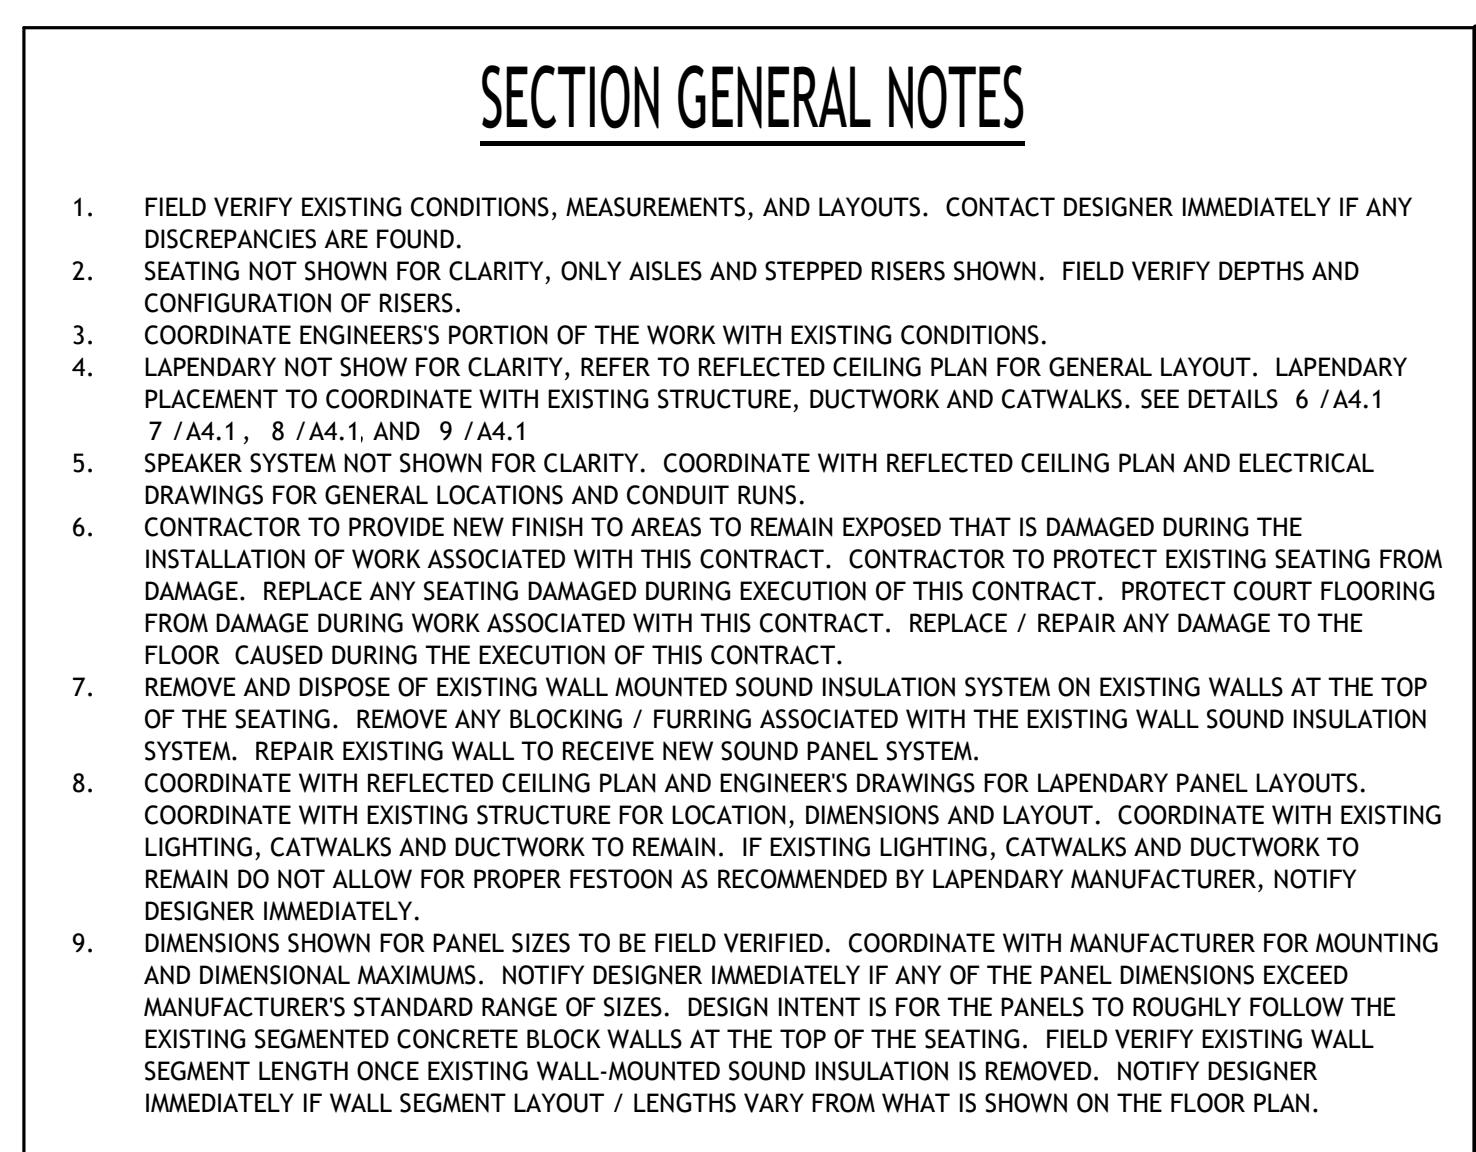

SECTION SIGNAGE

3

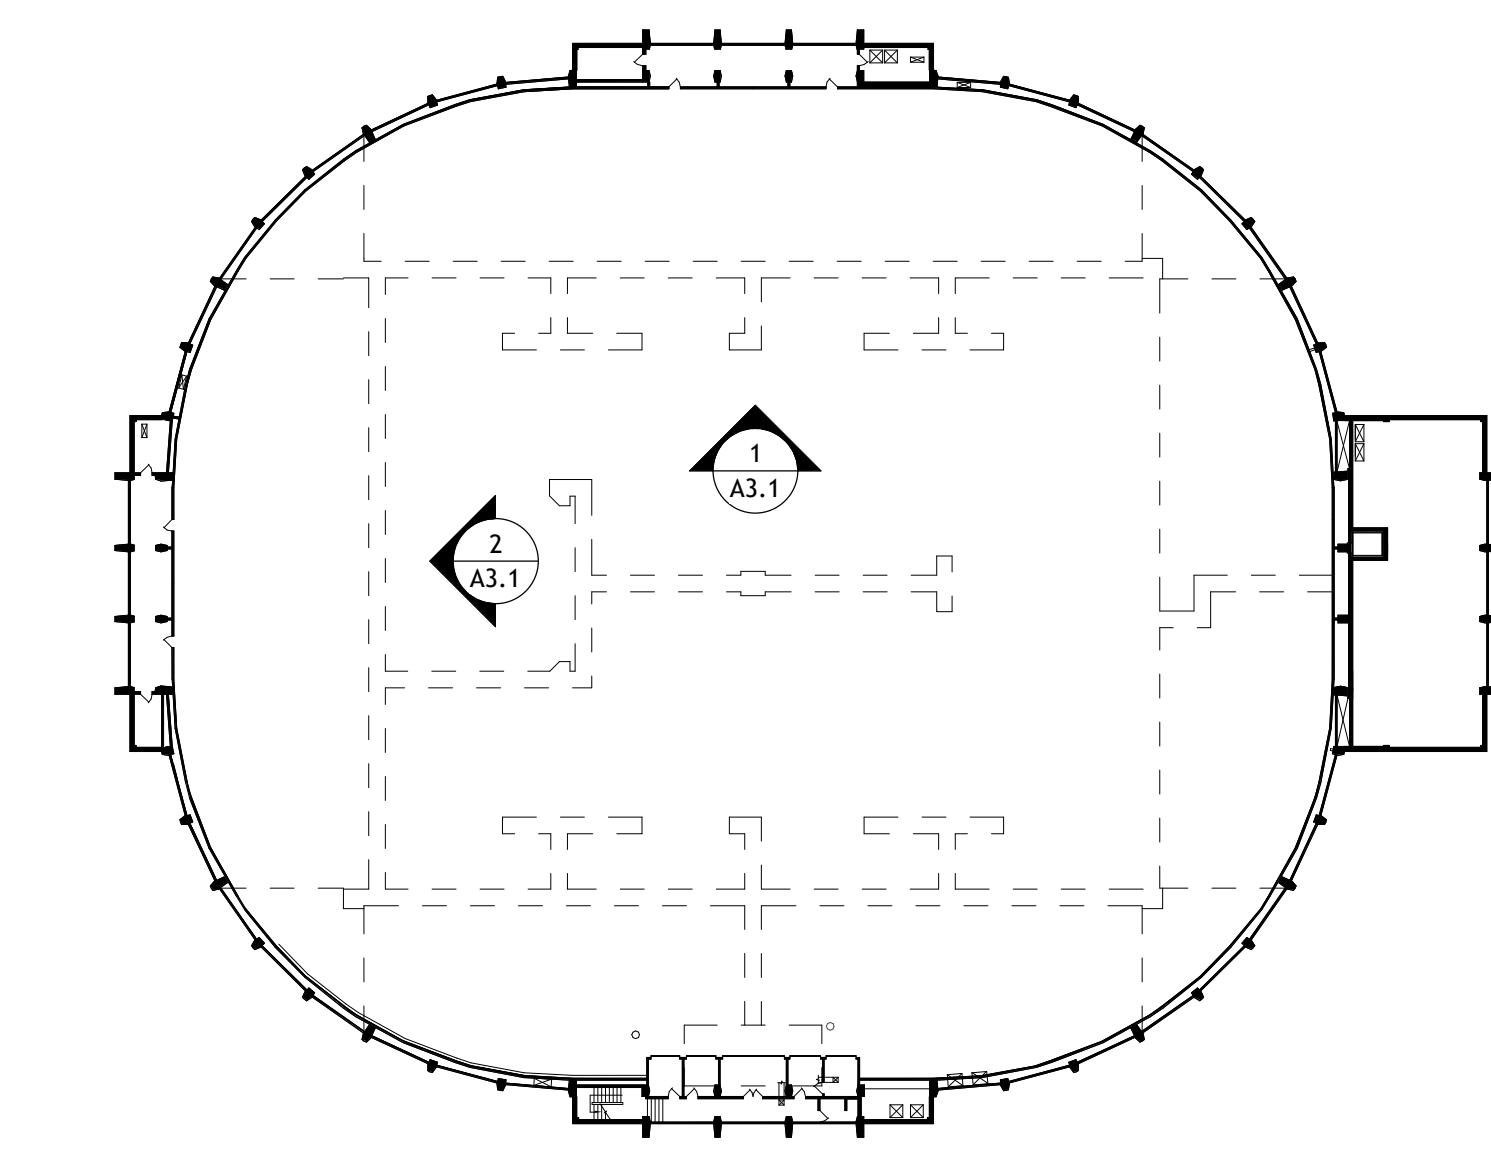

TENNESSEE TECHNOLOGICAL UNIVERSITY
HOOPER EBLEN CENTER SOUND SYSTEM REPLACEMENT
SBC #364/011-03-2025

LOCATION
TENNESSEE TECHNOLOGICAL UNIVERSITY COOKEVILLE, TENNESSEE





COPYRIGHT
THIS DRAWING, THE STYLIZED "UD" LOGO, AND THE DISTINCTIVE TYPEFACE & ARRANGEMENT COPYRIGHT (C) 2023 BY UPLAND DESIGN GROUP, INC. ALL RIGHTS RESERVED. THIS DRAWING IS THE PROPERTY OF UPLAND DESIGN GROUP, INC. AND MAY NOT BE USED, REUSED, COPIED IN ANY FORM, SOLD, DISPLAYED, MODIFIED WITHOUT WRITTEN PERMISSION.

REVISIONS
NO. DESCRIPTION DATE
1 Addendum 2 02/17/2026

JOB NO.
2518
ISSUE DATE
2-5-26
SHEET TITLE
BUILDING SECTIONS / INTERIOR ELEVATIONS

DRAWN
CWD
REVIEW
KAC
A3.1
KEY PLAN

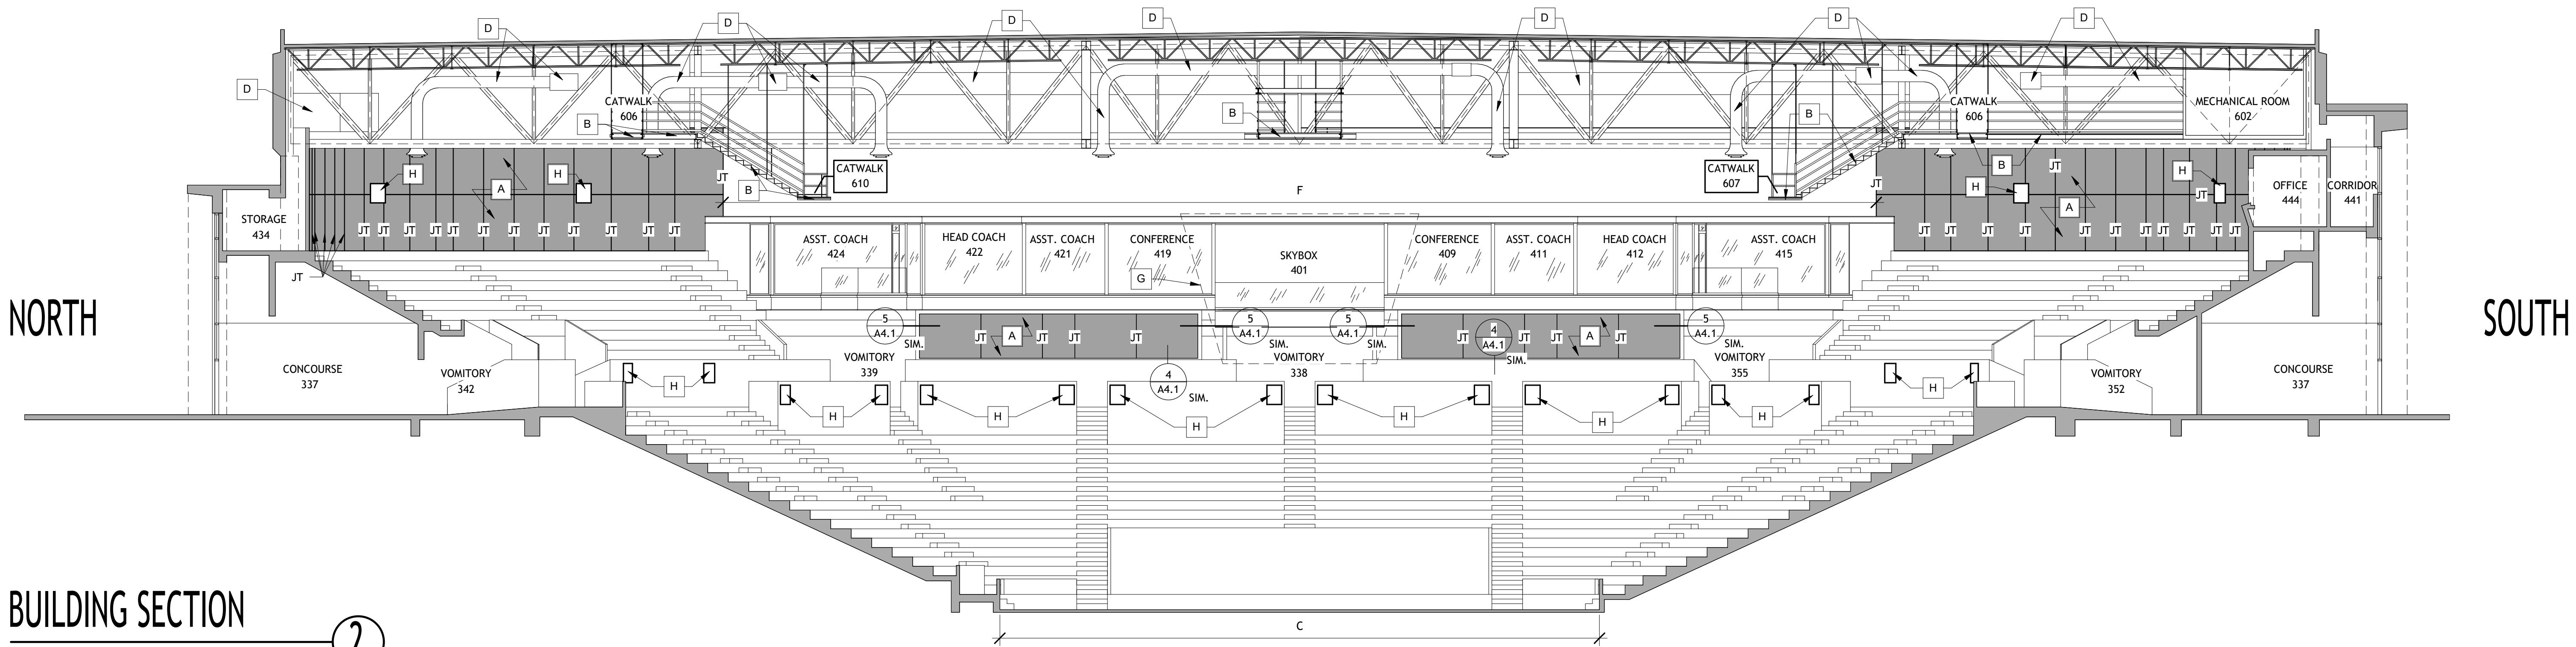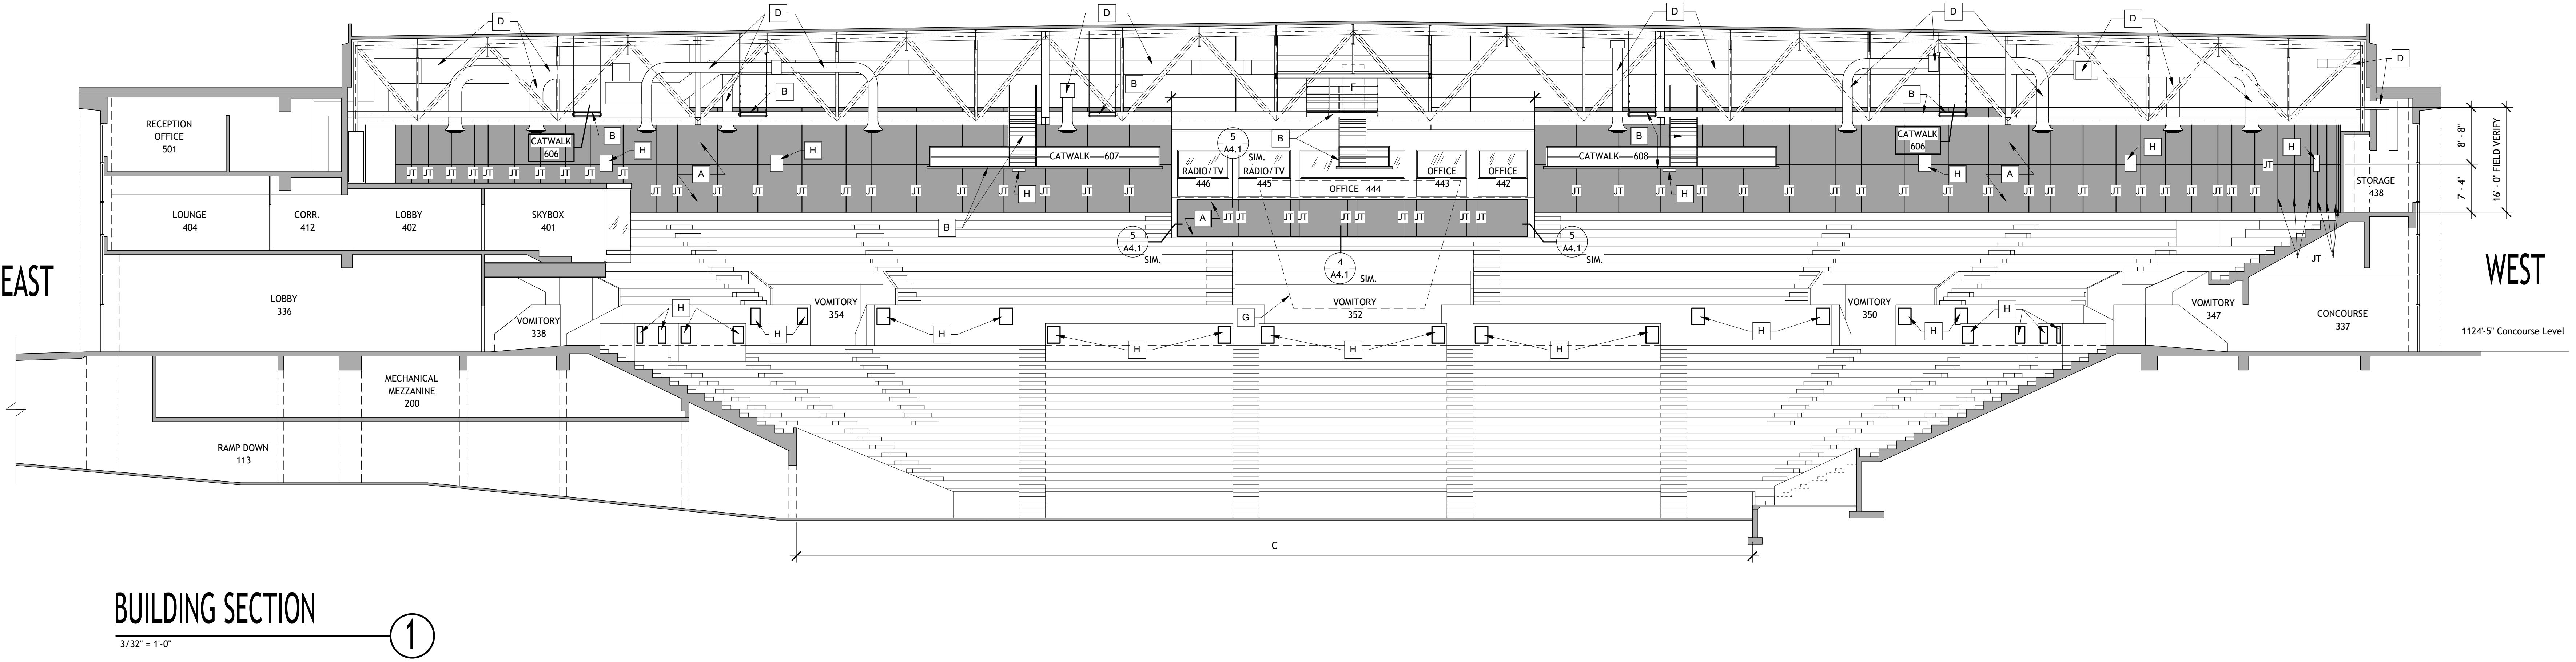


SECTION GENERAL NOTES


- FIELD VERIFY EXISTING CONDITIONS, MEASUREMENTS, AND LAYOUTS. CONTACT DESIGNER IMMEDIATELY IF ANY DISCREPANCIES ARE FOUND.
- SEATING NOT SHOWN FOR CLARITY, ONLY AISLES AND STEPPED RISERS SHOWN. FIELD VERIFY DEPTHS AND CONFIGURATION OF RISERS.
- COORDINATE ENGINEER'S PORTION OF THE WORK WITH EXISTING CONDITIONS.
- LAPENDARY NOT SHOWN FOR CLARITY, REFER TO REFLECTED CEILING PLAN FOR GENERAL LAYOUT. LAPENDARY PLACEMENT AND COORDINATE WITH EXISTING STRUCTURE, DUCTWORK AND CATWALKS. SEE DETAILS 6 /A4.1, 7 /A4.1, 8 /A4.1, AND 9 /A4.1
- SPEAKER SYSTEM NOT SHOWN FOR CLARITY, COORDINATE WITH REFLECTED CEILING PLAN AND ELECTRICAL DRAWINGS FOR GENERAL LOCATIONS AND CONDUIT RUNS.
- CONTRACTOR TO PROVIDE NEW FINISH TO AREAS TO REMAIN EXPOSED THAT IS DAMAGED DURING THE INSTALLATION OF WORK ASSOCIATED WITH THIS CONTRACT. PROTECT EXISTING FLOORING FROM DAMAGE. REPLACE ANY FLOORING DAMAGED DURING EXECUTION OF THIS CONTRACT. PROTECT COURT FLOORING FROM DAMAGE DURING WORK ASSOCIATED WITH THIS CONTRACT. REPLACE / REPAIR ANY DAMAGE TO THE FLOOR CAUSED DURING THE EXECUTION OF THIS CONTRACT.
- REMOVE AND DISPOSE OF EXISTING WALL MOUNTED SOUND INSULATION SYSTEM ON EXISTING WALLS AT THE TOP OF THE SEATING. REMOVE ANY BLOCKING / FURRING ASSOCIATED WITH THE EXISTING WALL SOUND INSULATION SYSTEM. REPAIR EXISTING WAY TO REFER TO NEW SOUND INSULATION SYSTEM.
- COORDINATE WITH REFLECTED CEILING PLAN AND ENGINEERS DRAWINGS FOR LAPENDARY PANEL LAYOUTS. COORDINATE WITH EXISTING STRUCTURE FOR LOCATION, DIMENSIONS AND LAYOUT. COORDINATE WITH EXISTING LIGHTING, CATWALKS AND DUCTWORK TO REMAIN. IF EXISTING LIGHTING, CATWALKS AND DUCTWORK TO REMAIN DO NOT ALLOW FOR PROPER FESTOON AS RECOMMENDED BY LAPENDARY MANUFACTURER, NOTIFY DESIGNER IMMEDIATELY.
- IMMEDIATELY NOTIFY DESIGNER IF ANY PANELS ARE IDENTIFIED. COORDINATE WITH REFLECTED CEILING PLAN AND DIMENSIONAL MARKINGS. NOTIFY DESIGNER IMMEDIATELY IF ANY OF THE PANEL LENGTHS EXCEED MANUFACTURER'S STANDARD RANGE OF SIZES. DESIGN INTENT IS FOR THE PANELS TO ROUGHLY FOLLOW THE EXISTING SEGMENTED CONCRETE BLOCK WALLS AT THE TOP OF THE SEATING. FIELD VERIFY EXISTING WALL SEGMENT LENGTH ONCE EXISTING WALL-MOUNTED SOUND INSULATION IS REMOVED. NOTIFY DESIGNER IMMEDIATELY IF WALL SEGMENT LAYOUT / LENGTHS VARY FROM WHAT IS SHOWN ON THE FLOOR PLAN.

SECTION KEY NOTES

- NEW WALL-MOUNTED FABRIC SOUND INSULATION SYSTEM. SYSTEM TO INCLUDE TRACK PERIMETER WITH INSULATION INFILL COVERED BY TEXTILE INFILL, TUCKED INTO TRACK PERIMETER. TRACK PERIMETER TO HAVE FABRIC RECEIVING JAWS FOR GRIPPING AND HOLDING FABRIC INTO PLACE. TRACK PERIMETER TO BE 1" IN DEPTH, MOUNTED ON 2" Z-FURRING WITH 3" OF TOTAL SOUND INSULATION INFILL. TRACK PERIMETER TO BE BLACK IN COLOR. INSULATION INFILL TO BE SOUND ABSORBING, IMPACT RESISTANT FIBERGLASS BOARD WITH 6# PCF DENSITY CORE. TEXTILE SYSTEM TO HAVE AN ACOUSTIC TENSILE OF 1.0 TO 1.1 NRC AND A FIRE TESTING OF AST-184-04. SYSTEM TO BE APPLIED TO EXISTING FLOORING. COORDINATE WITH REFLECTED CEILING PLAN FOR DIMENSIONS BETWEEN TRACK PERIMETERS. FIELD VERIFY DIMENSIONS. BASE OF DESIGN FOR FABRIC SOUND INSULATION SYSTEM IS FABTRAK SYSTEM BY FABTRAK SYSTEMS, INC. OF MT. LAUREL, NEW JERSEY. SIMILAR SYSTEMS BY NOVAL SYSTEMS, INC. OF ALEXANDRIA, VIRGINIA, SNAP-TEX OF MONTGOMERYVILLE, PENNSYLVANIA, AND FABRICATE WALL FINISHING SOLUTIONS OF VENTURA, CALIFORNIA.
- OUTLINE OF EXISTING CATWALK. FIELD VERIFY LOCATIONS, DIMENSIONS, AND HEIGHTS ABOVE FINISHED FLOOR. COORDINATE WITH LAPENDARY FOR EXISTING CATWALK.
- DUCTWORK TO EXISTING COURT TO REMAIN. PROTECT DURING CONSTRUCTION.
- EXISTING DUCTWORK TO REMAIN. FIELD VERIFY LOCATIONS, DIMENSIONS AND HEIGHTS ABOVE FINISHED FLOOR.
- EXISTING DOOR AND DOOR FRAME TO REMAIN. FIELD VERIFY LOCATIONS, DIMENSIONS AND SIZES.
- NO PANELS ABOVE SKYBOX OR PRESSBOX. PROVIDE CLOSURE EDGE TO ADJACENT PANELS SIMILAR TO DETAIL 5 /A4.1.
- EXISTING 8 SIDED, CENTER HUNG SCOREBOARD ABOVE THE BASKETBALL COURT TO REMAIN - OUTLINE ONLY SHOWN FOR CLARITY.
- SECTION SIGNAGE - COORDINATE WITH OWNER FOR COPY AND EXACT LOCATIONS. COORDINATE WITH MANUFACTURER FOR PROPER MOUNTING DEPENDING ON THE SURFACE.

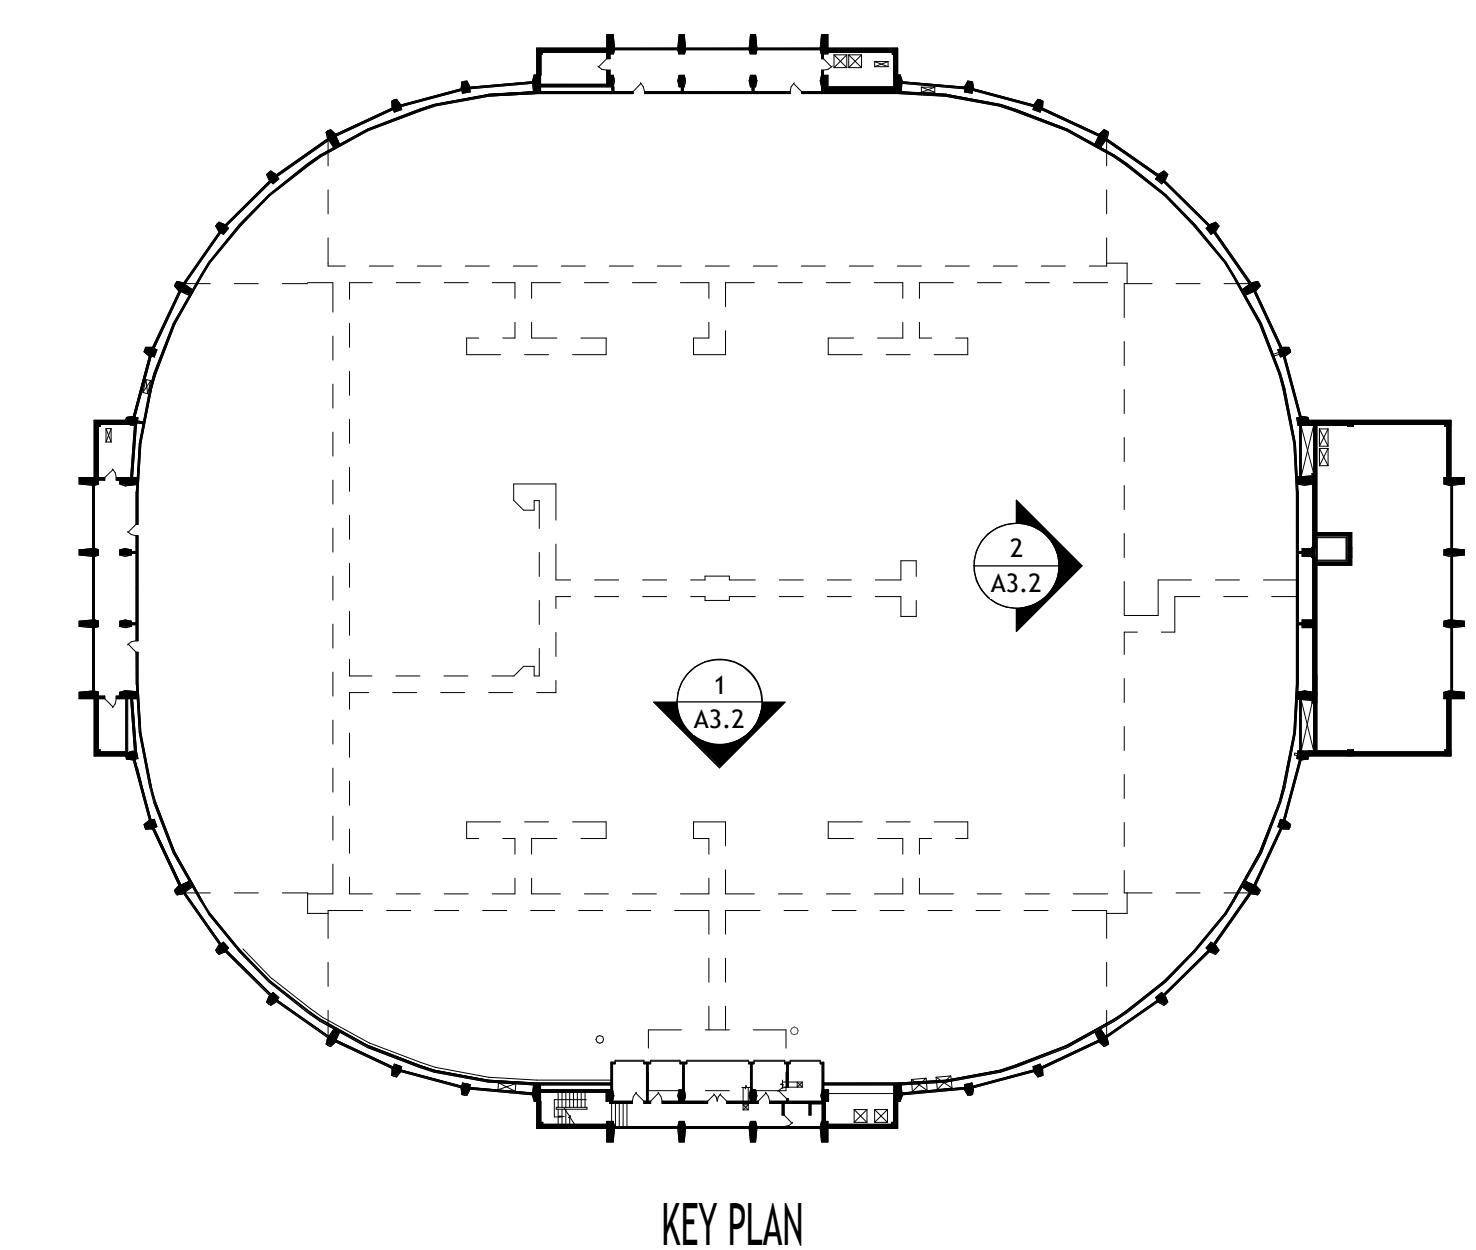

TENNESSEE TECHNOLOGICAL UNIVERSITY
HOOPER EBLEN CENTER SOUND SYSTEM REPLACEMENT
SBC #364/011-03-2025
LOCATION
TENNESSEE TECHNOLOGICAL UNIVERSITY COOKEVILLE, TENNESSEE
OWNER

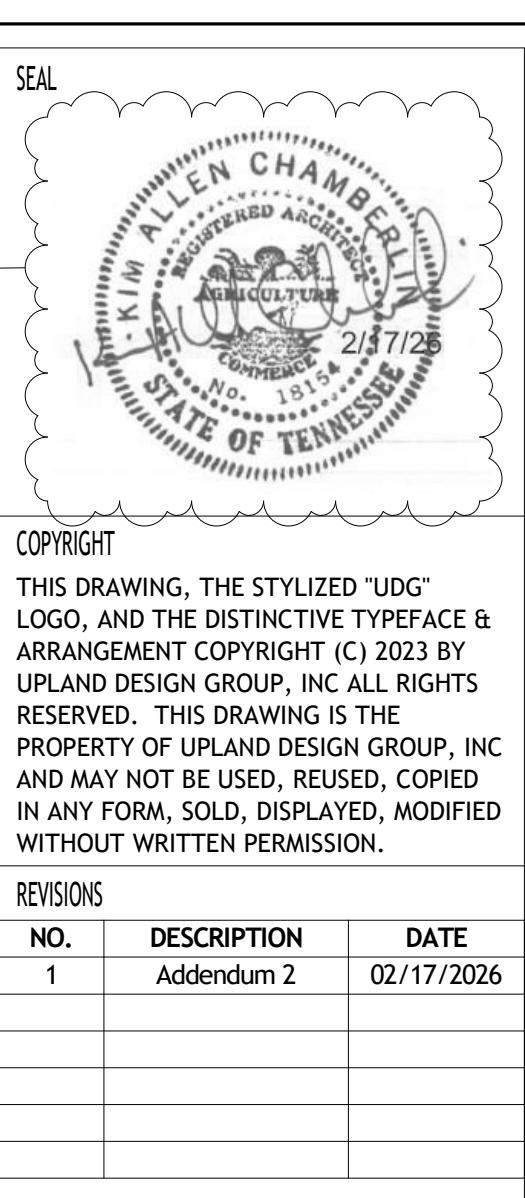

JOB NO. 2518
ISSUE DATE 2-5-26
SHEET TITLE BUILDING SECTIONS / INTERIOR ELEVATIONS
DRAWN CWD
REVIEW KAC